

Middle St. Croix Watershed Management Organization 2023 Water Monitoring Summary



Prepared For:

Prepared by:



MIDDLE ST. CROIX
WATERSHED MANAGEMENT ORGANIZATION



WASHINGTON
OBSERVATION
DISTRICT

This Page Intentionally Left Blank.

ACKNOWLEDGEMENTS

Multiple agencies and individuals were directly involved in many aspects of this project, such as data collection and data analysis, as well as technical and administrative assistance.

Middle St. Croix WMO (MSCWMO) Board of Managers

Annie Perkins, Secretary

John Dahl

Avis Peters

Brian Zeller, Chair

Dave Millard

Tom McCarthy, Vice Chair

Carly Johnson

Beth Olfelt-Nelson, Treasurer

Ryan Collins

John Buelow

Washington Conservation District

Matthew Oldenburg-Downing, MSCWMO Administrator

Metropolitan Council

Brian Johnson

Jennifer Keville

Steven Louwerse

Mike Moger

Patricia Phua

Monica Rose

Mallory Vanous

Minnesota Department of Natural Resources (MN DNR)

Sandy Fecht

The WCD would also like to thank the volunteers and landowners who assist with data collection and allow property access.

TABLE OF CONTENTS

ABBREVIATIONS, DEFINITIONS, ACRONYMS, AND SYMBOLS	4
EXECUTIVE SUMMARY	5
LAKE MONITORING	8
A. METHODS, RESULTS AND DISCUSSION.....	8
1. LILY LAKE	11
2. MCKUSICK LAKE	12
STREAM AND STORMWATER MONITORING.....	17
A. LILY LAKE INLET TARGETED MONITORING	17
B. PERRO CREEK MONITORING.....	21
C. BROWN’S CREEK DIVERSION STRUCTURE.....	27
MSCWMO: CONCLUSIONS AND RECOMMENDATIONS	30
A. LAKES.....	30
B. TARGETED MONITORING.....	32
C. STREAMS	33
APPENDIX A.....	A1
WATER QUALITY DATA – LILY LAKE AND MCKUSICK LAKE	A1

ABBREVIATIONS, DEFINITIONS, ACRONYMS, AND SYMBOLS

Anoxic	Lacking oxygen
BCWD	Brown's Creek Watershed District
Benthic	The area nearest lake bed
Biweekly	Every two weeks
BMP	Best management practice
cf	cubic feet
cfs	cubic feet per second
Chl- α	Chlorophyll- α
DO	Dissolved oxygen
<i>E. coli</i>	<i>Escherichia coli</i>
IESF	Iron enhanced sand filter
Littoral zone	The area of a body of water where sunlight penetrates to the sediment and allows aquatic plants (macrophytes) to grow
MCES	Metropolitan Council Environmental Services
mg/L	milligram per liter
mL	milliliter
MN DNR	Minnesota Department of Natural Resources
MPCA	Minnesota Pollution Control Agency
MPN	Most probable number
MSCWMO	Middle St. Croix Watershed Management Organization
NAVD 88	North American Vertical Datum of 1988, used for determining lake elevations
NGVD 29	National Geodetic Vertical Datum of 1929, used for determining lake elevations
OHW	Ordinary high water level
SOP	Standard operating procedure
TKN	Total Kjeldahl nitrogen
TP	Total phosphorus
TSI	Trophic State Index
TSMP	Trout Stream Mitigation Project
TSS	Total suspended solids
$\mu\text{g/L}$	micrograms per liter
$\mu\text{mhos/cm}$	micromhos per centimeter
VSS	Volatile suspended solids
WCD	Washington Conservation District

EXECUTIVE SUMMARY

This report focuses on the summary and comparison of lake and stream water quality data collected by the Washington Conservation District (WCD) in 2023, as well as previous years. In 2023 the Middle St. Croix Watershed Management Organization (MSCWMO) monitored water quality and water surface elevation on McKusick Lake and Lily Lake, and flow and water quality at the Greeley Street Inlet to Lily Lake and at Perro Creek at the Diversion Structure (Figure 1). The purpose of this monitoring is to assess and document current water quality conditions of the lakes and streams, as well as continuation of a long-term monitoring program that will enable the MSCWMO to identify trends associated with best management practice (BMP) implementation and land use changes in the watershed. Also included in this report is data collected at the Brown's Creek Diversion Structure, which is a tributary to McKusick Lake that is monitored by the WCD for the Brown's Creek Watershed District (BCWD).

Lake Monitoring

Lily Lake was classified as oligotrophic and received an A grade in 2023 (APPENDIX A). All samples collected June – September met the Minnesota Pollution Control Agency's (MPCA) standards for total phosphorus (TP) and for chlorophyll- α (chl- α) corrected for pheophytin. All Secchi disk transparency measurements also met the MPCA standard (APPENDIX A).

In 2023 McKusick Lake was classified as eutrophic and received a grade of B- (APPENDIX A). All samples collected June – September met the Minnesota Pollution Control Agency's standards for total phosphorus and for chlorophyll- α corrected for pheophytin. All Secchi disk transparency measurements met the MPCA shallow lake standard (APPENDIX A).

Stream and Stormwater Monitoring

Monitoring continued at the Greeley Street inlet to Lily Lake in 2023 and the total recorded discharge was the lowest recorded at the site at 387,945 cubic feet. This was due in large part to the third consecutive year of severe drought conditions, as well as datalogger malfunction late in the monitoring season. Four water quality grab samples were collected during monthly baseflow

sampling from Brick Pond and one grab sample was collected after a storm event, but when flow was only coming from Brick Pond. No samples were collected during storm events. The average TP concentration from baseflow samples was 0.115 mg/L and the average TSS concentration was 5 mg/L. TP and TSS loads to Lily Lake were calculated during monitored periods using sample results from 2020-23. In 2023 the TP load was 2.3 lbs and the TSS load was 141 lbs.

Water quality sampling continued on Perro Creek at the Diversion Structure in 2023 and the total recorded discharge to the St. Croix River was 12,936,648 cubic feet, which included discharge through the overflow structure. This was an increase from 2022 but drought conditions still caused decreases in flow and affected baseflow and stormflow sampling in 2023. All baseflow samples had TP results that were less than the laboratory's reporting limit. The average baseflow TSS concentration was 2 mg/L, which was similar to the baseflow averages since 2019. The average TP concentration from storm samples collected in 2023 was 0.216 mg/L, which was the lowest storm average since 2018. The average TSS concentration from storm samples was 102 mg/L, which was higher than in 2022 but lower than in 2021. TP and TSS loads to the St. Croix River were calculated only during monitored periods, and in 2023 the TP load was 27.3 lbs and the TSS load was 5,091 lbs.

Discharge at the Brown's Creek Diversion Structure site decreased from 2022 to 2023 due to the drought conditions, with a volume of 35,622,586 cubic feet exported to McKusick Lake. The total annual TP and TSS loads also slightly decreased, and were 367 lbs and 74,875 lbs, respectively. Concentrations of metals were again low in 2023. There was one copper result and two lead results that exceeded MPCA chronic standards.

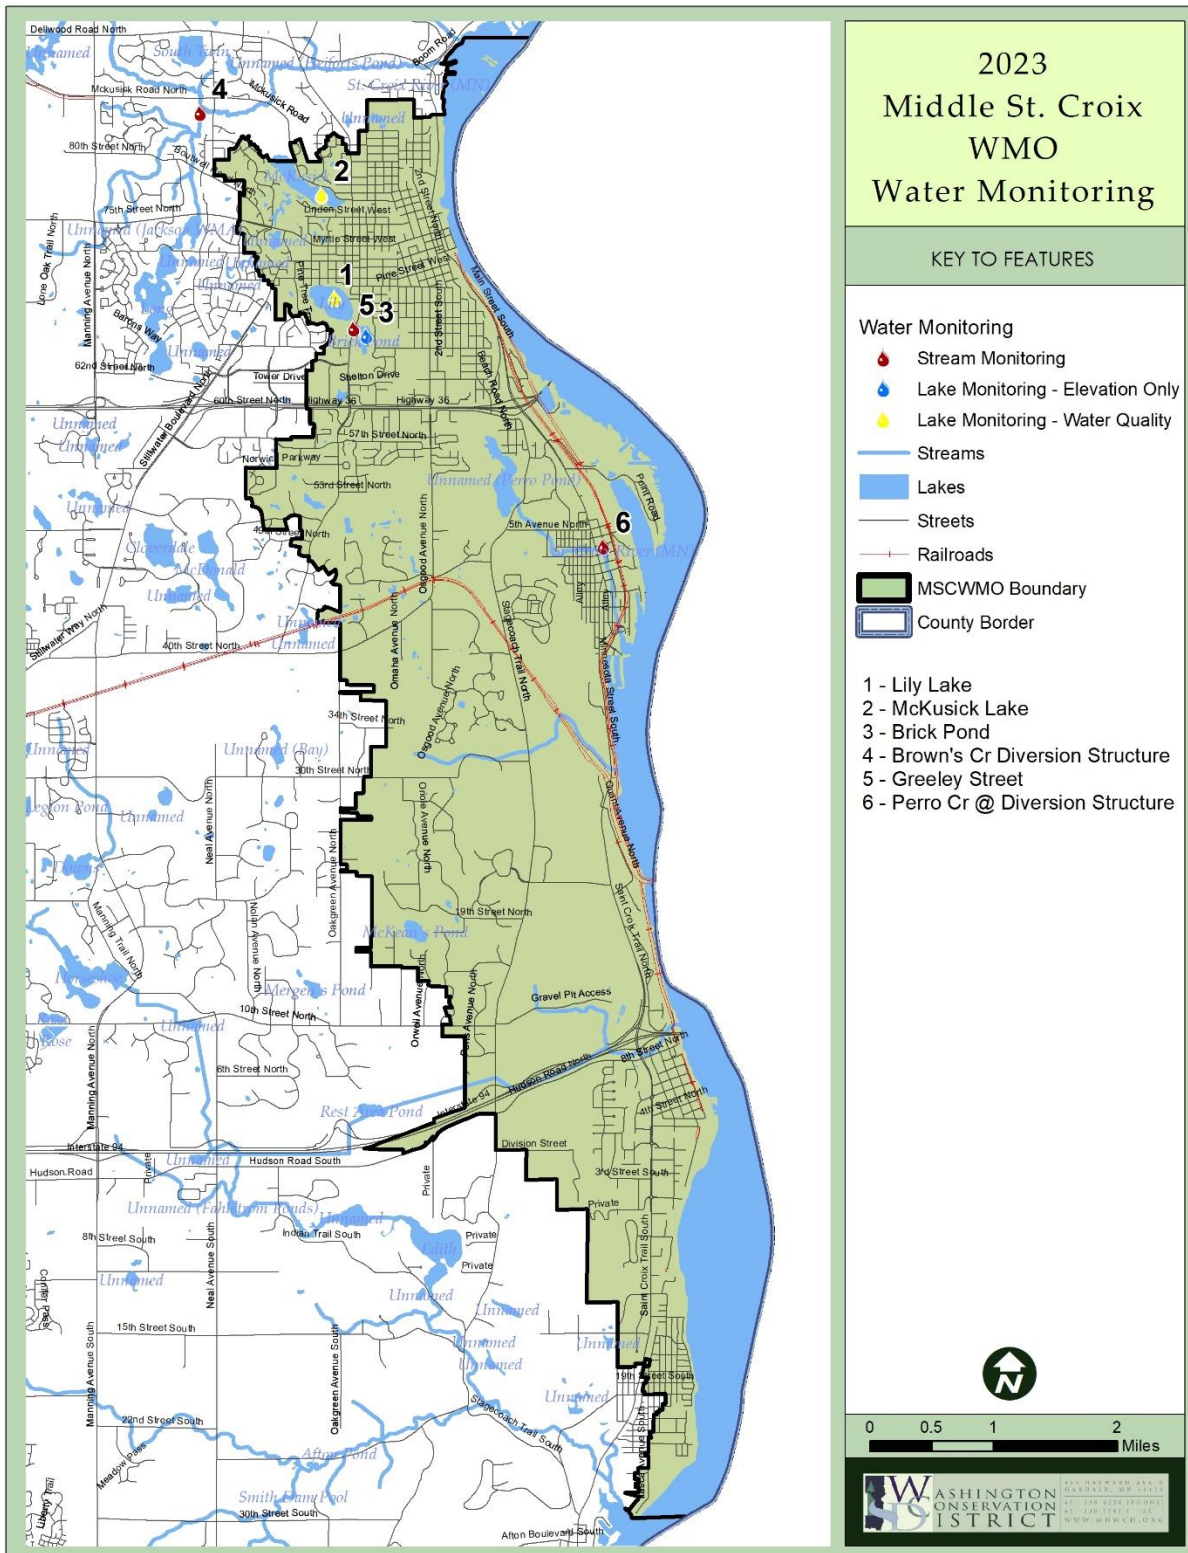


Figure 1. MSCWMO 2023 Water Monitoring Locations

LAKE MONITORING

A. METHODS, RESULTS AND DISCUSSION

In 2023 water quality data was collected biweekly on Lily Lake and McKusick Lake, over seven consecutive months (April–October) by the WCD. Measurements obtained during the summer sampling season (June–September) are averaged for a comparison of individual lake dynamics from year to year between lakes within the watershed and to the Minnesota Pollution Control Agency’s (MPCA) impairment standards. Lake grades are based on the averages of samples collected May–September. Average values for all parameters are presented in APPENDIX A and Figure 2 through Figure 5, which show the current and historic summer averages for each parameter. Water quality samples were collected by the WCD with a two-meter (6.56 feet) integrated surface water column sampler. A full description of WCD Standard Operating Procedures (SOP) is available on the Washington Conservation District website at <http://www.mnwcd.org/water-monitoring>. The Metropolitan Council Environmental Services (MCES) Laboratory analyzed the surface water samples for TP, chl- α , and total Kjeldahl nitrogen (TKN).

Total phosphorus is analyzed as it is a major nutrient involved in the eutrophication of lakes and is generally associated with the growth of aquatic plants and/or algal blooms. Common sources of phosphorus include runoff from agricultural fields, livestock areas, urban areas, lakeshore lawns, and improperly operating septic systems. With most lakes in this region, phosphorus is the least available nutrient; therefore, its abundance or scarcity controls the extent of algal growth. Excess algal growth, in turn, negatively affects the clarity, or transparency, and ability of light to penetrate the water. The MPCA sets lake eutrophication standards for aquatic life and recreation. The standard for TP is 0.040 mg/L for deep lakes and 0.060 mg/L for shallow lakes. In general, shallow lakes are defined as less than 15 feet deep, with greater than 80% littoral area, and less than 10 acres. The 2023 summer average of TP values of MSCWMO lakes can be found in Figure 2.

Chlorophyll- α is measured because it’s the photosynthetic component found in algae and aquatic plants and is an indicator of algal productivity. The MPCA standard for pheophytin-corrected

chl- α is 14 $\mu\text{g/L}$ for deep lakes and 20 $\mu\text{g/L}$ for shallow lakes. The 2023 summer average chl- α concentrations of MSCWMO lakes can be found in Figure 3.

TKN, the sum of organic nitrogen and ammonia, was analyzed in MSCWMO lakes. While no standard exists for TKN because TP is often the limiting nutrient, TKN can contribute to eutrophication. The 2023 summer average TKN concentrations of MSCWMO lakes can be found in Figure 4

Field measurements are recorded while collecting lake samples, including Secchi disk transparency. The measurement of light penetration using a Secchi disk gives a simple measure of water transparency, or clarity. A reduction in water transparency is typically the result of turbidity composed of suspended sediments, organic matter and/or phytoplankton (algae). The MPCA standard for Secchi disk transparency is 1.4 meters for deep lakes and 1.0 meter for shallow lakes. The 2023 summer average transparency of MSCWMO lakes can be found in Figure 5.

User perception and physical/recreational suitability of lakes were recorded, along with temperature and dissolved oxygen (DO) profile measurements taken by the WCD during each sampling event. Profiles are recorded at one-meter increments from the water surface to the lake bottom. The data show the extent of summer stratification and are useful in identifying the development of a thermocline (the layer of water in which the temperature rapidly declines). As a lake stratifies, the water column becomes more stable and mixing is less likely to occur. If mixing occurs during the growing season, nutrients from the lake bottom become available and can result in increased algal production. Lake DO profile data is useful in determining excessive production (algae/plants) in a lake. Increased production creates more DO, for a time, but as plants and algae die off and decay, the bacteria that decompose them consume DO. Low DO conditions may stress fish populations and under anoxic conditions nutrients may be released from the sediment. Data collected from the rankings and profiles are contained in a database at the WCD, and can be obtained by request, as well as on the MPCA website at <https://webapp.pca.state.mn.us/surface-water/search>.

A lake grading system is used in this summary, to allow for a better understanding of lake water quality data and to aid in the comparison of lakes. The lake water quality grading system was developed following the 1989 sampling season by MCES. The concept of the lake grading system is a ranking of water quality characteristics by comparing measured values to those of other metro area lakes. The grading system represents percentile ranges for three water quality indicators: the May through September average values of TP, uncorrected trichromatic chl- α , and Secchi disk transparency. These percentiles use ranked data from 119 lakes sampled from 1980-1988 and are shown in Table 1. This method has since been replicated and the grading system has been verified with more recent data. The variables used in the grading system strongly correlate to open-water nuisance aspects of a lake (i.e. algal blooms), which can indicate accelerated aging (cultural eutrophication). There is a strong correlation when comparing trophic status to the lake grade. Summaries of all lake results are presented in APPENDIX A.

Table 1. Lake Grade Ranges

Grade	Percentile	TP ($\mu\text{g/L}$)	Chl-α ($\mu\text{g/L}$)	SD (m)
A	<10	<23	<10	>3.0
B	10-30	23-32	10-20	2.2-3.0
C	30-70	32-68	20-48	1.2-2.2
D	70-90	68-152	48-77	0.70-1.2
F	>90	>152	>77	<0.70

There are several metrics and systems that can also be used to assess lakes including the Carlson Trophic State Index (TSI) and ecoregion values. The Carlson Trophic State Index is used to quantify the relationship between water quality data and trophic status. Trophic states vary from oligotrophic (low biological activity and high clarity) to hypereutrophic (highly productive with very low clarity). The MSCWMO is located in the North Central Hardwood Forest Ecoregion where lakes are often mesotrophic. Ecoregion values are assigned for TP, TKN, chl- α , and Secchi disk transparency. This report will focus on the methods used by the MPCA and the Metropolitan Council, as previously discussed.

Water elevation monitoring was conducted on two lakes, McKusick and Lily, from April to October 2023. Lake elevation readings are compared to the lake's Ordinary High Water level (OHW)¹. The OHW for Lily and McKusick Lakes are 844.8 ft. and 851.7 ft., respectively (NGVD 29). Changes in lake water elevation are often attributed to the changes in precipitation. The highest recorded elevation in 2023 for Lily Lake occurred on 4/24/2023 at 846.42 ft. and on 4/24/2023 at 855.06 ft. for McKusick Lake. Complete lake elevation data for 2023 can be found in APPENDIX A. For historical lake elevations, visit the MN DNR Lake Finder webpage at <http://www.dnr.state.mn.us/lakefind/index.html>.

Water elevation monitoring also occurred on Brick Pond by a volunteer, May to October. The lowest recorded elevation was on 6/25/2023 at 847.60 ft and the highest was on 10/16/2023 at 848.65 ft (NAVD 88).

1. LILY LAKE

In 2023 WCD staff conducted two-tailed Kendall's Tau statistical analysis based on data collected by professional agencies for both lakes monitored in MSCWMO to determine trends for TP, Secchi, and chl- α ($p < 0.05$). Lily Lake had a statistically significant improving trend for TP and average Secchi disk transparency, and no trend was found for chl- α . Lily Lake had an average summertime TP concentration of 0.022 mg/L, which was higher than 2022 average of 0.013 (Figure 2). All eleven summertime results met the MPCA lake nutrient impairment standard for TP. The 2023 average summertime concentration of chl- α was 2.5 $\mu\text{g/L}$, lower than the 3.4 $\mu\text{g/L}$ measured in 2022 (Figure 3). All eleven water quality results for chl- α met the MPCA lake impairment standard (APPENDIX A). Lily Lake had an average summertime TKN concentration of 0.50 mg/L in 2023; lower than the average of 0.61 mg/L in 2022 (Figure 4).

¹ Minnesota State Statutes defines the ordinary high water level (OHW) as follows: Minnesota Statutes 103G.005 Subd. 14. Ordinary High Water Level. "Ordinary high water level" means the boundary of water basins, watercourses, public waters and public waters wetlands, and: The ordinary high water level is an elevation delineating the highest water level that has been maintained for a sufficient period of time to leave evidence upon the landscape, commonly the point where the natural vegetation changes from predominantly aquatic to predominantly terrestrial;

- 1) For watercourses, the ordinary high water level is the elevation of the top of the bank of the channel; and
- 2) For reservoirs and flowages, the ordinary high water level is the operating elevation of the normal summer pool.

Secchi disk readings were measured in 2023 with a summertime average of 4.11 meters (Figure 5), with all eleven water quality readings meeting the MPCA lake standard for Secchi disk transparency (APPENDIX A). Lily Lake received an A grade in 2023, matching the A it received in 2022. Temperature and DO profiles indicate that Lily Lake exhibited thermal stratification during the summer months with the thermocline between 4 and 6 meters; therefore, the lake was less likely to completely mix throughout the summer. The elevation was above the OHW for the beginning monitoring season, with the highest recorded level occurring on 4/24/2023 with a level of 846.42 ft. The lowest recorded level of the monitoring season occurred on 9/12/2023 with an elevation of 844.60 ft, below the OHW. A summary of all lake results is presented in APPENDIX A.

2. MCKUSICK LAKE

A two-tailed Kendall's Tau analysis based on data collected by professional agencies showed that McKusick Lake has statistically significant ($p < 0.05$) improving trends for TP, chl- α , and Secchi transparency. The McKusick Lake summertime average TP concentration in 2023 was 0.037 mg/L; higher than the 0.035 mg/L observed in 2022 (Figure 2). All eleven summertime samples collected in 2023 met the MPCA shallow lake standard for TP (APPENDIX A).

McKusick Lake had a summertime average chl- α concentration of 8.7 $\mu\text{g/L}$; higher than the chl- α average of 5.0 $\mu\text{g/L}$ from 2022 (Figure 3). All eleven summertime samples collected in 2023 met the MPCA shallow lake standard for chl- α . The average summertime TKN concentration in 2023 was 0.70 mg/L, lower than the 0.83 mg/L in 2022 (Figure 4). The 2023 summertime average water transparency measured by Secchi disk was 2.08 meters (Figure 5). All eleven summertime Secchi disk readings in 2023 met the MPCA shallow lake impairment standard. McKusick Lake received a grade of a B- in 2023, a downgrade from the B it received in 2022. No temperature and DO profiles were collected so the occurrence of thermal stratification in the deepest part of the lake cannot be determined. A majority of McKusick Lake is very shallow and does not stratify, and therefore is likely to have mixed throughout the summer. The elevation of McKusick Lake remained above the OHW for the entire monitoring season, reaching its highest recorded level of the season on 4/24/2023 with a level of 855.06 ft. and the lowest recorded level of the season occurred on 9/12/2023 with an elevation of 853.95 ft. A summary of all lake results is presented in APPENDIX A.

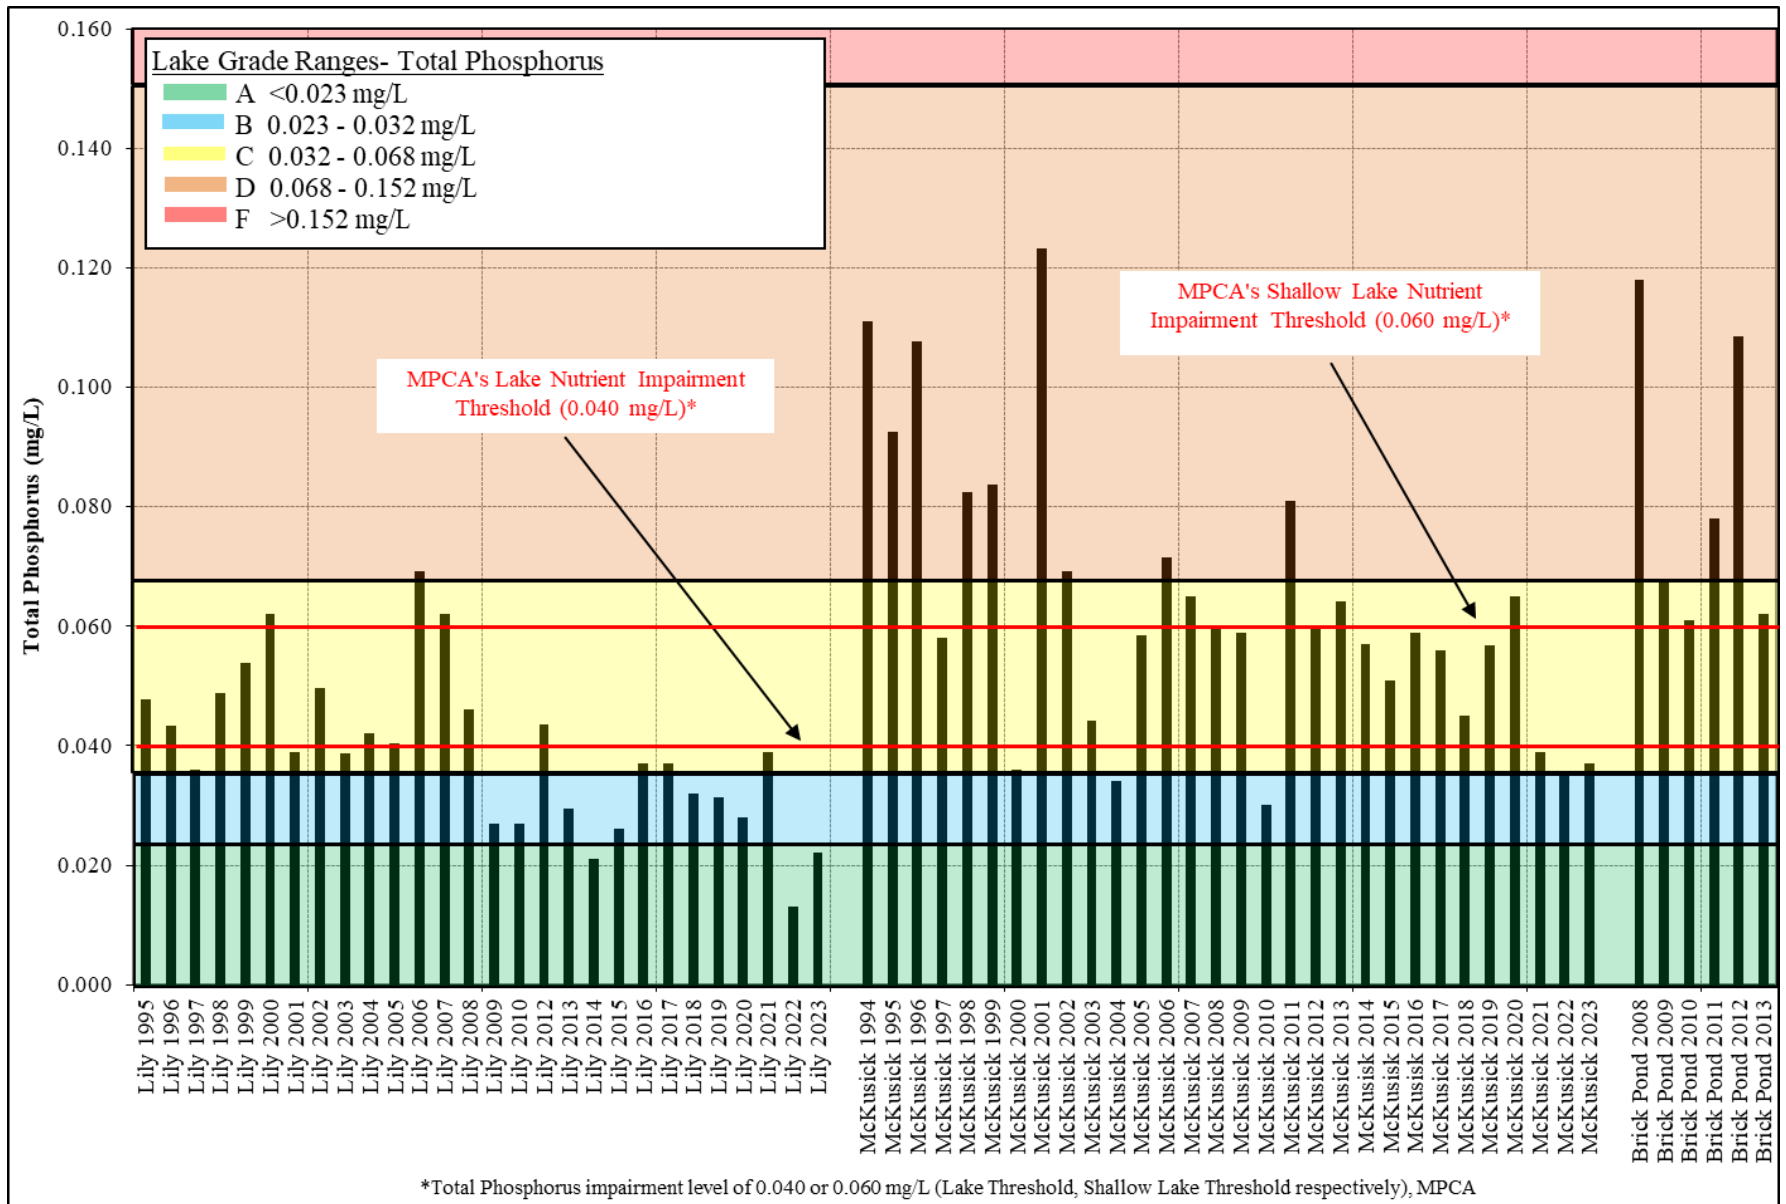


Figure 2. MSCWMO Historic Summer Average Total Phosphorus

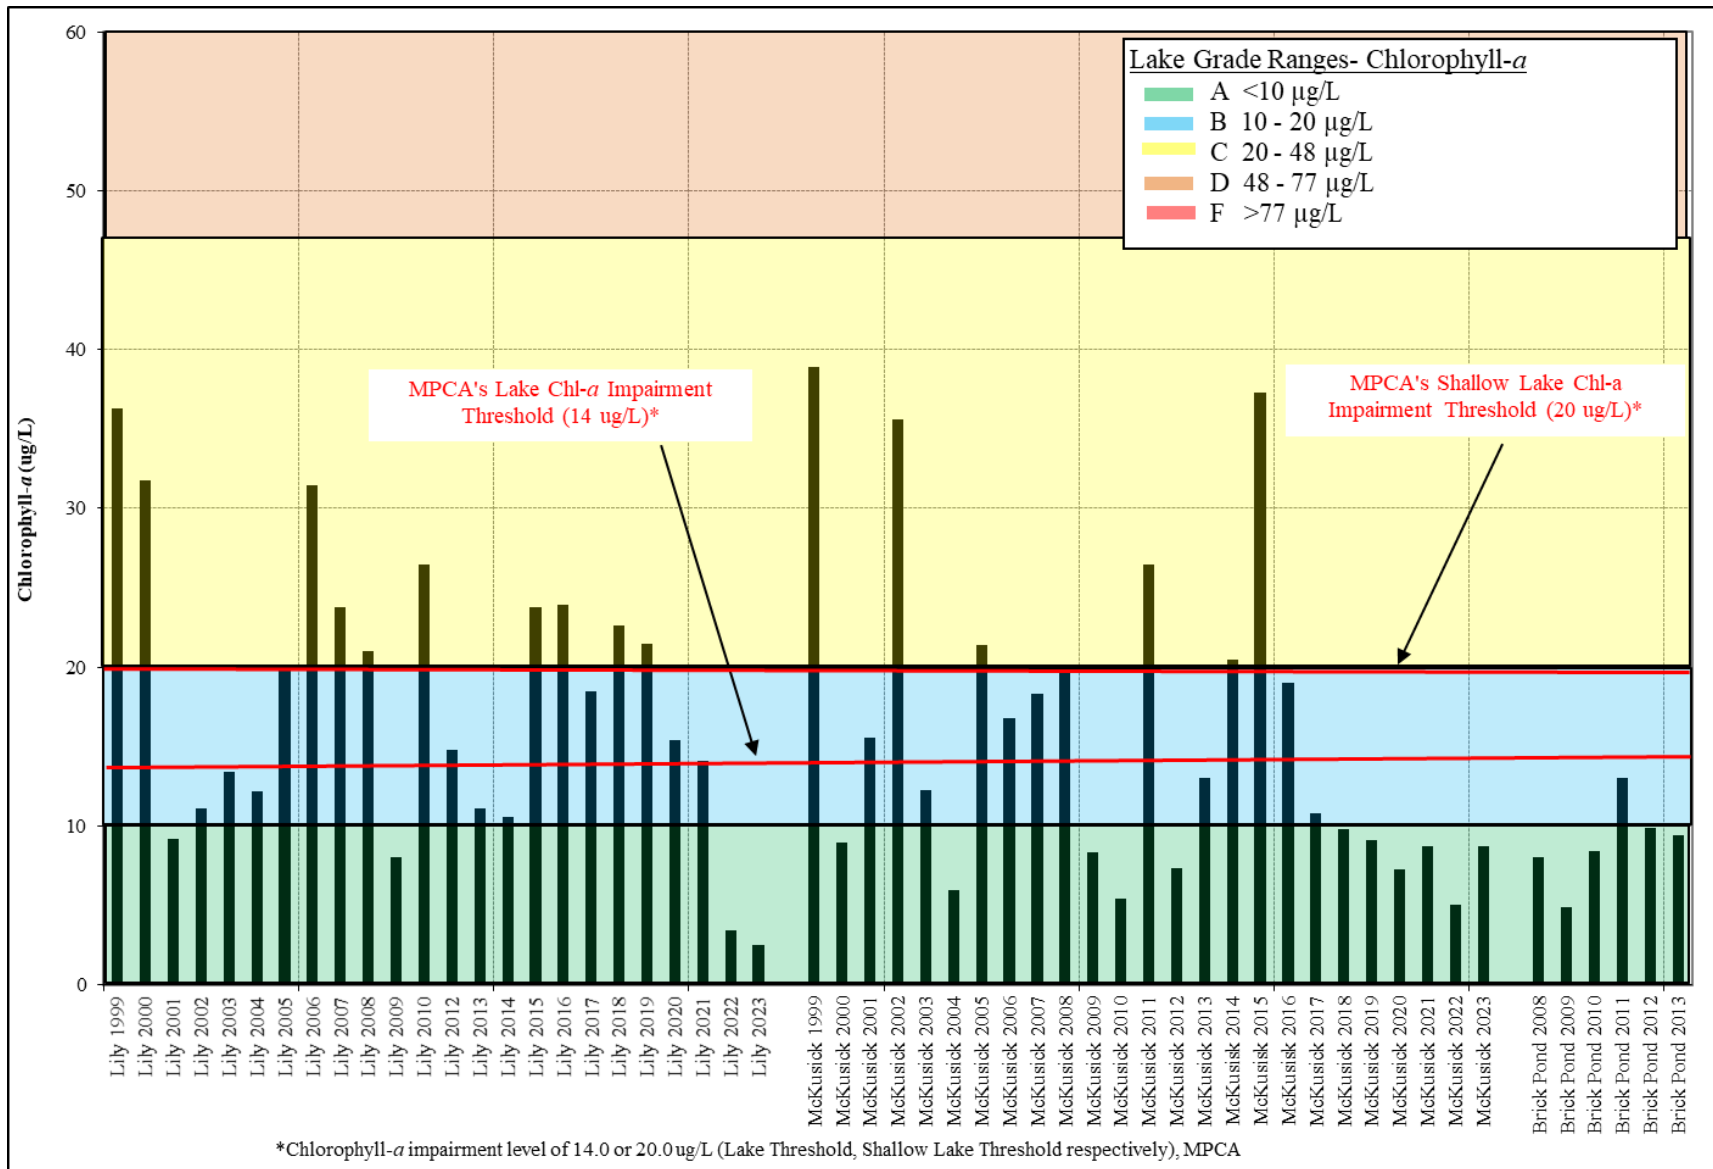


Figure 3. MSCWMO Historic Summer Average Chlorophyll-a

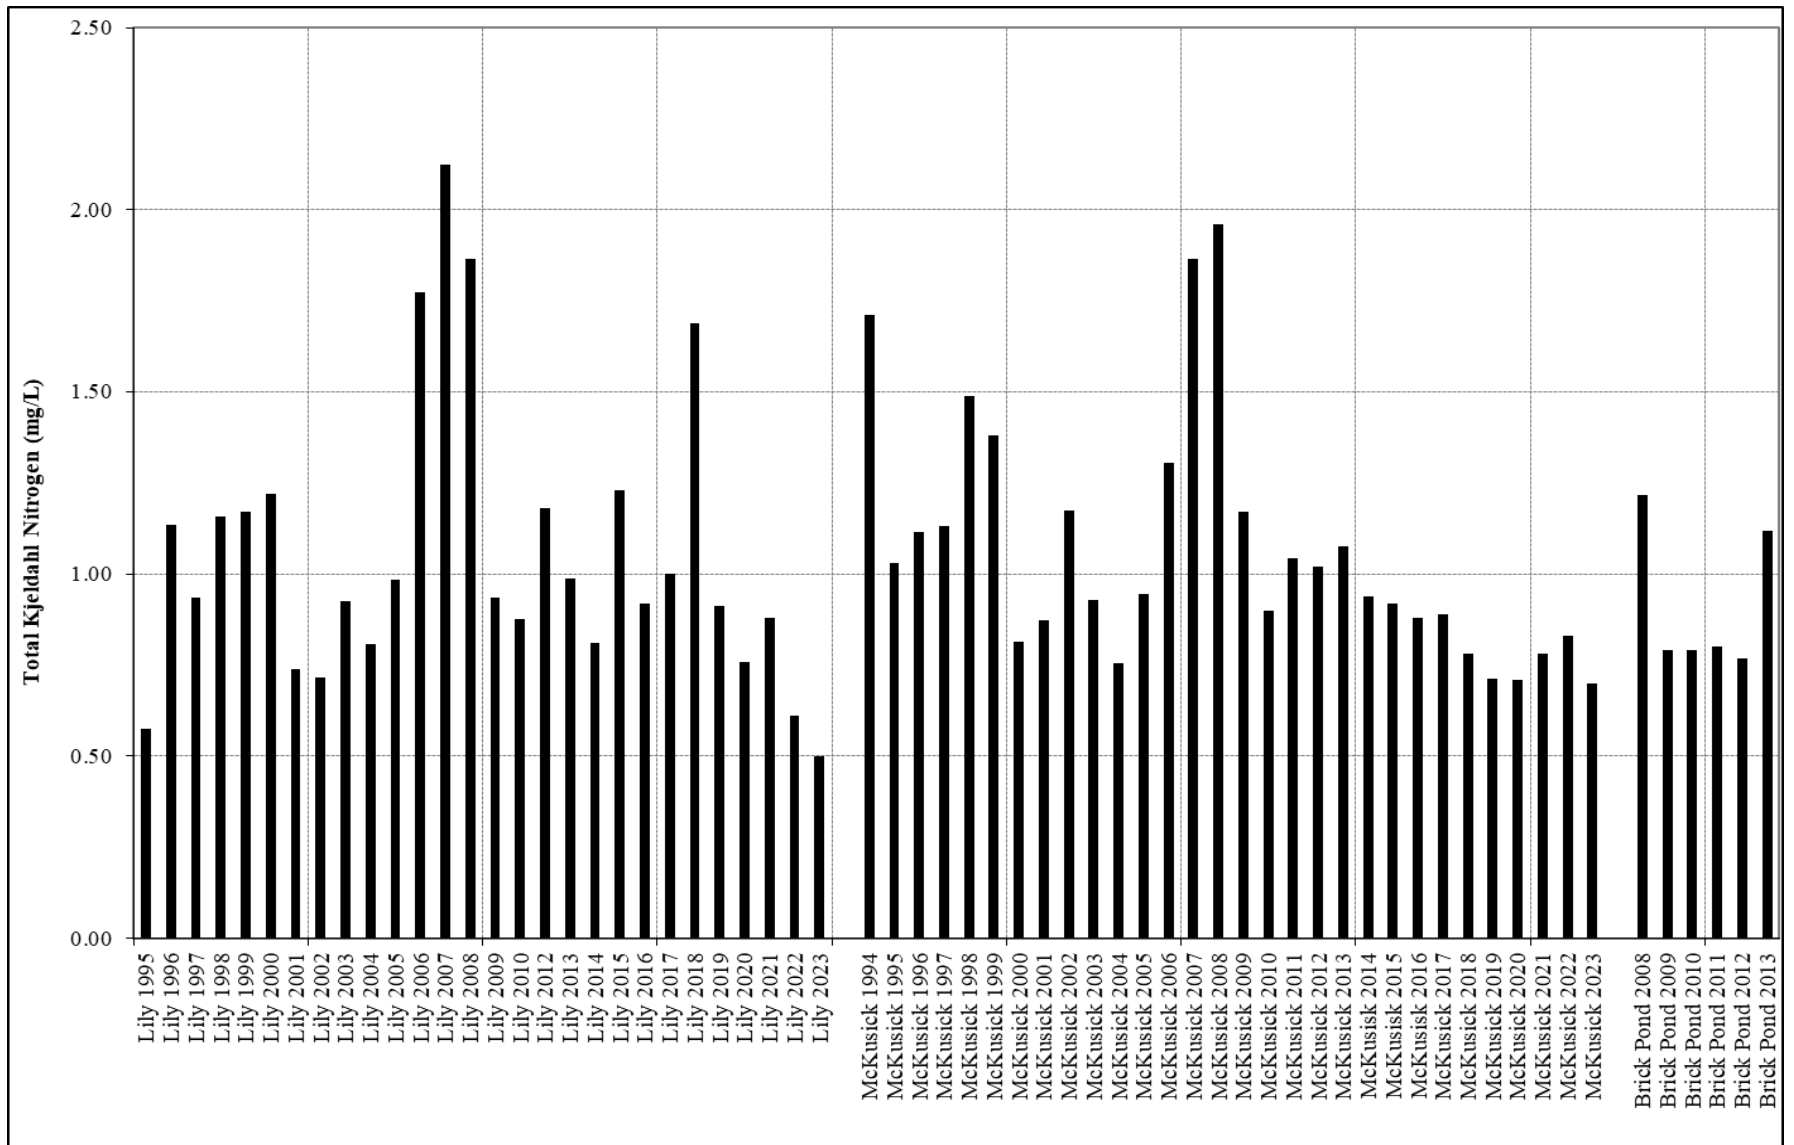


Figure 4. MSCWMO Historic Summer Average Total Kjeldahl Nitrogen

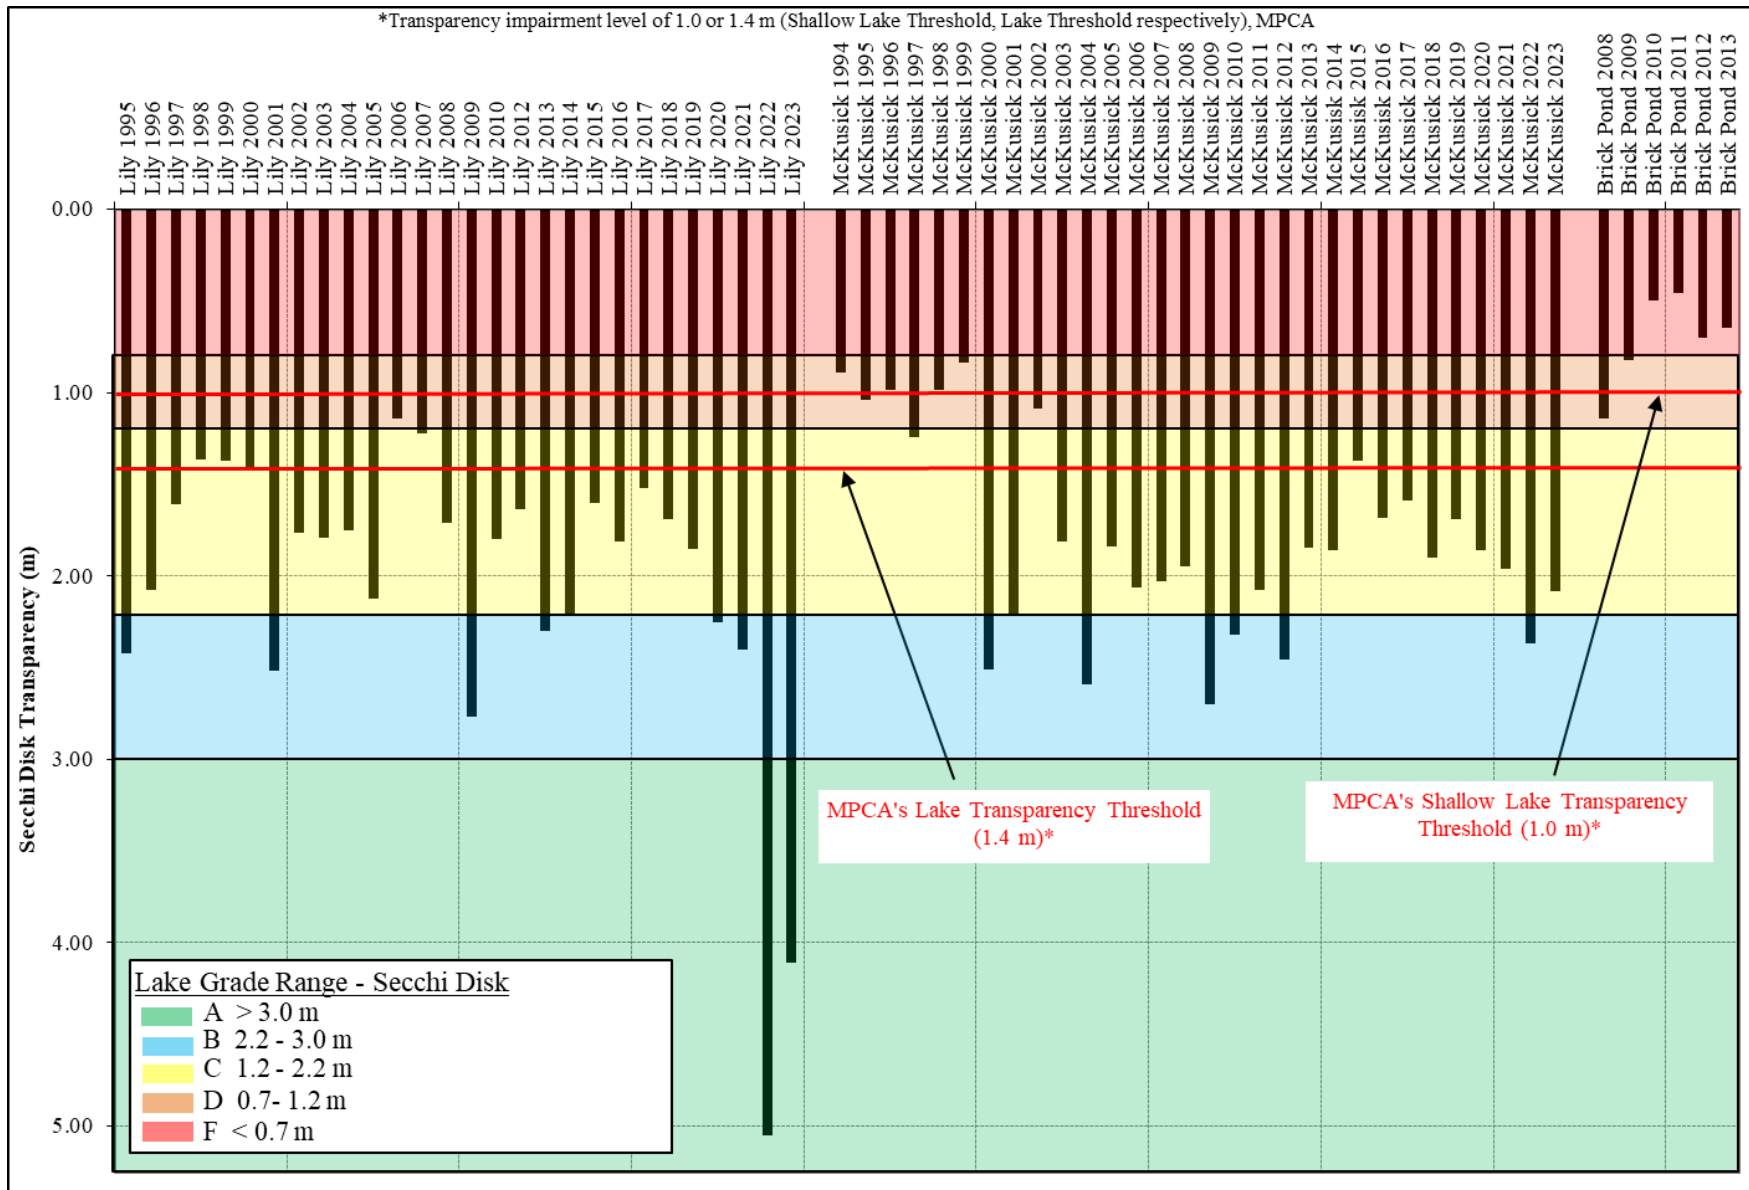


Figure 5. MSCWMO Historic Summer Average Secchi Disk Transparency

STREAM AND STORMWATER MONITORING

A. LILY LAKE INLET TARGETED MONITORING

In 2015 the MSCWMO received grant funding to conduct targeted water quality monitoring on Lily Lake with the goal of identifying priority areas for nutrient load reduction to the lake. The MSCWMO worked closely with the WCD to develop and implement a monitoring plan to achieve this goal.

As in prior years, the monitoring in 2023 focused on the Greeley Street catchment. Continuous 15-minute stage and velocity data were collected in the catchment basin from 5/11/23 – 9/11/23. The datalogger's internal battery malfunctioned and no data could be downloaded after 9/11/23. The equipment was discontinued by the manufacturer and could not be repaired. Discharge was calculated using an area/velocity relationship and the recorded discharge to Lily Lake in 2023 was 387,945 cubic feet, which was a decrease from 2022 (Table 2, Figure 6, and Figure 7). As in 2021 and 2022, the decrease in discharge in 2023 was due in large part to severe drought conditions and there were extended periods of very low or no flow throughout the entire monitoring season. The datalogger also malfunctioned and was installed for a shorter period in 2023, similar to 2022. Because of the low flow conditions and few rain events, only five water quality grab samples were collected and analyzed for total phosphorus, total Kjeldahl nitrogen, and total suspended solids in 2023 (Table 3). Storm sampling has historically been limited by the nature of the site as storm events at the Greeley Street catchment can be flashy. Urban storm runoff is transported quickly and this makes capturing a sample more difficult during these periods.

Four water quality grab samples were collected during monthly baseflow sampling from Brick Pond (5/30, 8/21, 9/26, and 10/10) and one grab sample was collected after a storm event, but when flow was only coming from Brick Pond (8/14). The average TP concentration from baseflow samples was 0.115 mg/L (Table 4). Two baseflow samples had higher than average TP concentrations for this site but were within historic ranges for baseflow. The average TSS concentration from baseflow samples was 5 mg/L. TP and TSS loads to Lily Lake were

calculated during monitored periods, and in 2023 the TP load was 2.3 lbs (Table 2 and Figure 6) and the TSS load was 141 lbs (Table 2 and Figure 7). The 2023 dataset was not considered robust for calculating loads, and therefore sample results from 2020-23 were used to calculate the TP and TSS loads.

Table 2. Greeley Street 2023 Monitored Discharge and TP & TSS Loading

Site	Date range	Discharge (cf)	Discharge (ac-ft)	Percent of Total Discharge	TP Load (lbs)	Percent of TP Load	TSS Load (lbs)	Percent of TSS Load
Greeley St. Baseflow ¹	5/11/23 - 9/11/23	371,592	8.54	96%	2.1	89%	103	73%
Greeley St. Stormflow ¹	5/11/23 - 9/11/23	16,353	0.38	4%	0.3	11%	38	27%
Total		387,945	8.91	100%	2.3	100%	141	100%

¹ TP and TSS averages from 2020-23 data were used for load calculations to better represent variability in flow conditions

Table 3. Greeley Street 2023 Water Quality Results

Date	Sample Type	TP (mg/L)	TSS (mg/L)	TKN (mg/L)	Discharge (cfs)
5/30/23 15:16	Base ¹	0.321	<6	1.10	0.02
8/14/23 9:06	Base/Storm	0.051	5	0.92	0.37
8/21/23 10:21	Base	0.153	12	1.40	<0.01
9/26/23 9:08	Base ¹	<0.050	4	0.67	NA
10/10/23 9:14	Base ¹	<0.050	<3	0.70	NA


¹ TP/TSS results that are less than the Reporting Limit were divided in half when calculating averages

Table 4. Greeley Street Historical TP and TSS Averages and Ranges

Greeley Street Sample Type	2015	2016	2017	2018	2019	2020	2021	2022	2023
Baseflow Samples	3	6	5	8	6	5	4	1	5
Stormflow Samples	6	5	2	1	1	1	4	2	0
TP (mg/L) - Baseflow Average	0.091	0.070	0.060	0.066	0.077	0.046	0.081	0.166	0.115
Baseflow Range ^a	0.028 - 0.210	0.029 - 0.122	0.045 - 0.083	0.040 - 0.126	0.046 - 0.134	0.036 - 0.791	<0.020 - 2.09	NA	<0.05 - 0.321
TP (mg/L) - Stormflow Average	0.219	0.437	0.104	0.316	0.110	0.199	0.360	0.093	NA
Stormflow Range	0.063 - 0.382	0.059 - 0.744	0.089 - 0.119	NA	NA	NA	0.214 - 0.593	0.086 - 0.100	NA
TSS (mg/L) - Baseflow Average	4	2	3	4	2	2	5	9	5
Baseflow Range ^b	1 - 9	1 - 6	1 - 7	1 - 8	1 - 3	1 - 3	2 - 220	NA	<3 - 12
TSS (mg/L) - Stormflow Average	48	233	35	518	8	38	49	13	NA
Stormflow Range	2 - 132	10 - 616	28 - 41	NA	NA	NA	32 - 88	6 - 20	NA

^a In 2023 the laboratory changed TP reporting to as low as the Reporting Limit (0.05 mg/L) rather than the Method Detection Limit (0.02 mg/L)

^b Beginning in 2022 the laboratory changed TSS reporting to as low as the Reporting Limit (3 mg/L) rather than the Method Detection Limit (1 mg/L)

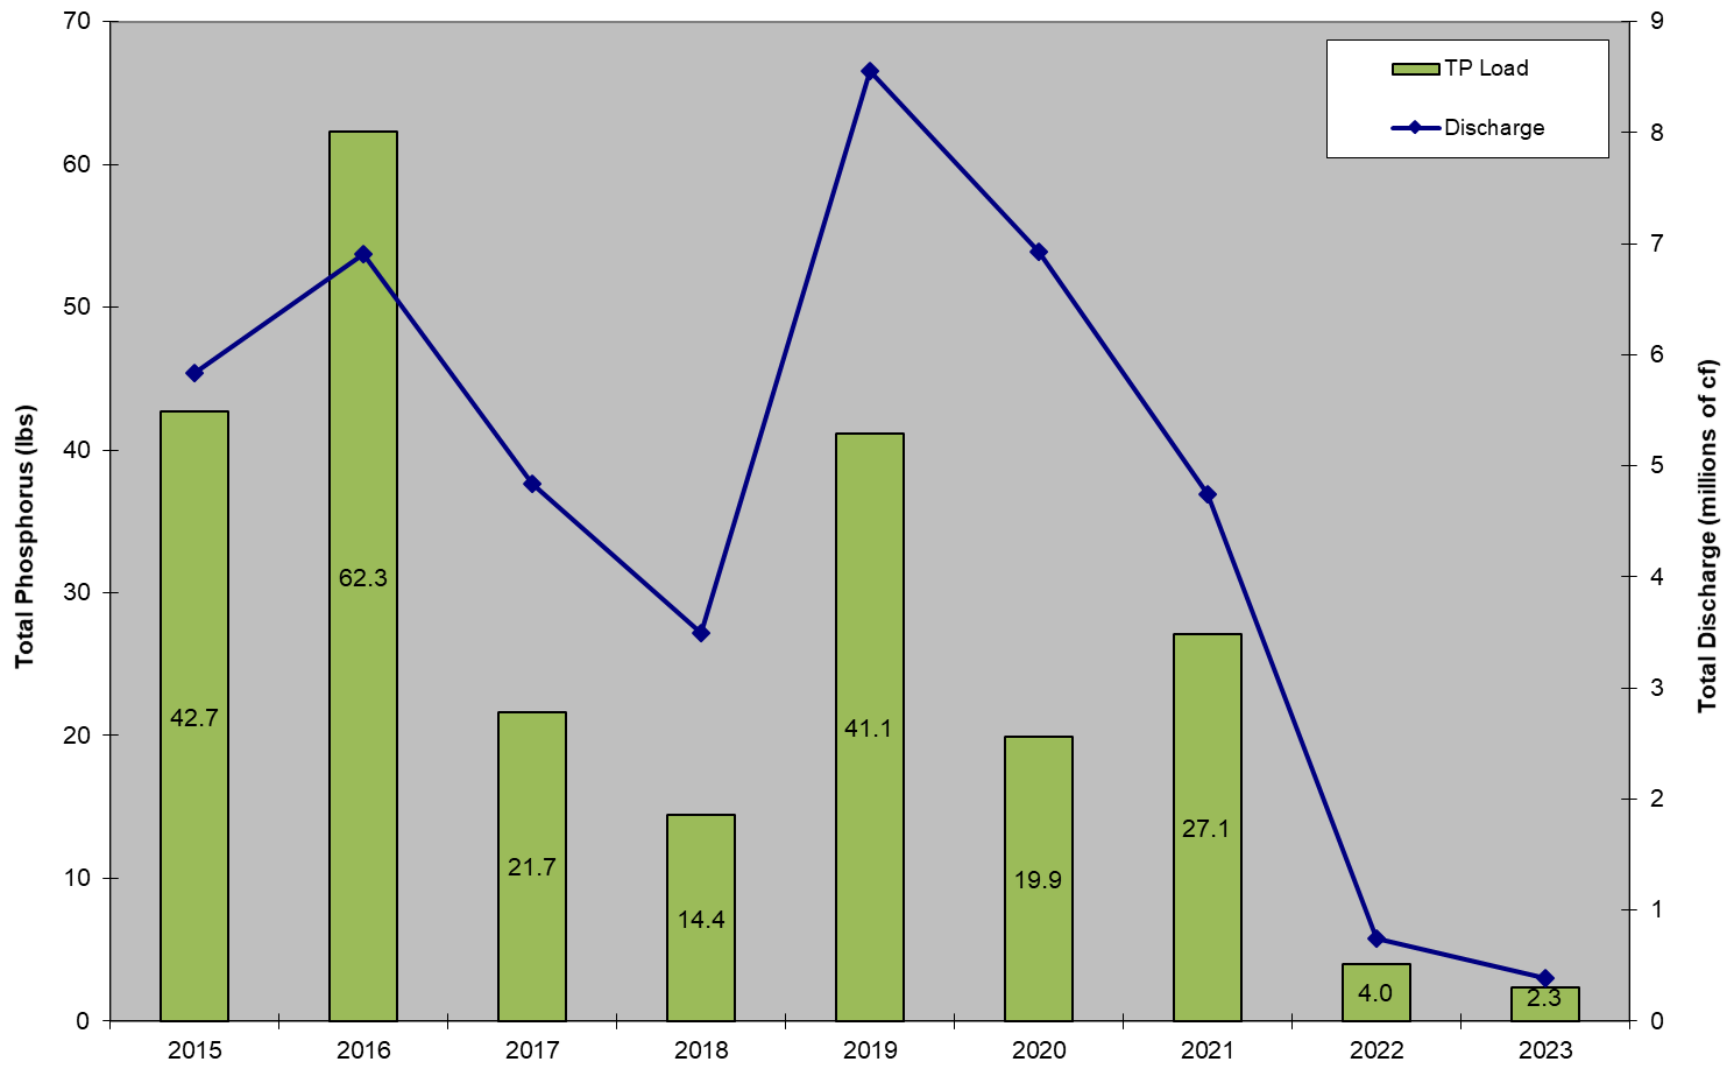

The datalogger in 2022 and 2023 was installed for a shorter time period (7/11/22 - 10/27/22 and 5/11/23 - 9/11/23).

Figure 6. Greeley Street Monitored Discharge and Total Phosphorus Load

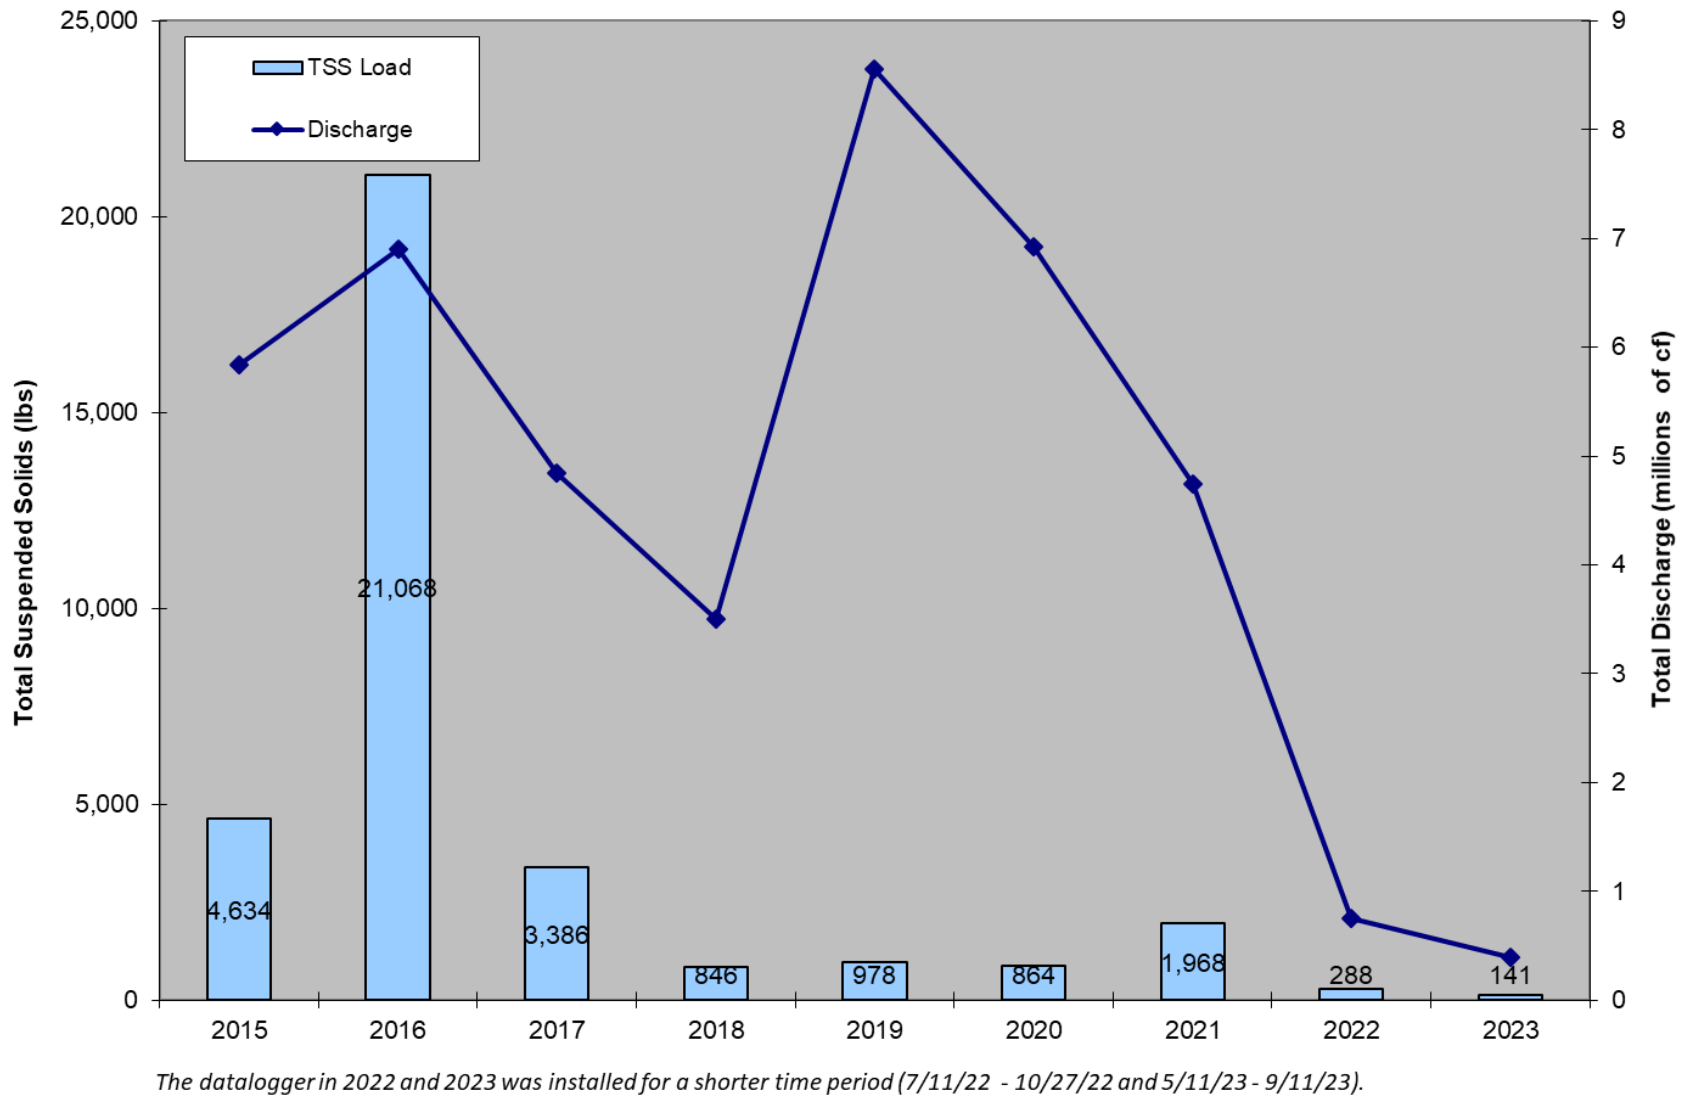


Figure 7. Greeley Street Monitored Discharge and Total Suspended Solids Load

B. PERRO CREEK MONITORING

The goal of monitoring Perro Creek in 2016-2017 was to identify where the greatest contribution of nutrients and sediment to the St. Croix River was occurring. Monitoring continued in 2018 and 2019 to further refine previous observations. In 2020 water monitoring activities were reduced on Perro Creek and no traditional water quality samples were collected. Beginning in 2021, and continuing through 2023, water quality sampling was conducted on Perro Creek at the Diversion Structure site by collecting in-stream grab samples during baseflow periods and using an automated sampler to collect flow-weighted composite storm samples. The automated sampler allowed for multiple samples to be collected during storm events, which were then combined into one sample representing the storm event. This methodology can provide more accurate data for calculating nutrient loads during storm events than grab samples alone. Continuous 15-minute stage and velocity data were collected at the site and in the Diversion Structure Overflow from 5/23/23 – 10/23/23. Discharge was calculated using an area/velocity relationship, and the recorded discharge in 2023 to the St. Croix River was 12,936,648 cubic feet (Table 5).

Eleven water quality samples were collected in 2023 and analyzed for several parameters, including total phosphorus, total Kjeldahl nitrogen, and total suspended solids (Table 6). Six baseflow grab samples were collected monthly June – October and five composite storm samples were collected July – September. All baseflow samples had TP results that were less than the laboratory's reporting limit and five of the samples had TSS results that were less than the reporting limit. These results were divided in half when calculating averages (Table 7). The low TP results fell within the historic ranges for this site. The 2023 baseflow average TSS concentration was 2 mg/L, which was similar to the baseflow averages since 2019. The TSS result from the 10/10 sample was considered an outlier and was excluded from the baseflow average. The average TP concentration from storm samples collected in 2023 was 0.216 mg/L, which was the lowest storm average since 2018 (Table 7). The average TSS concentration from storm samples was 102 mg/L, which was higher than in 2022 but lower than in 2021. TP and TSS loads to the St. Croix River were calculated for both the creek and the Diversion Structure

Overflow during monitored periods. In 2023 the TP load was 27.3 lbs (Table 5 and Figure 8) and the TSS load was 5,091 lbs (Table 5 and Figure 9).

Perro Creek is listed as impaired for TSS on the MPCA's 303(d) Impaired Waters List. The stream is in the Central River Nutrient Region and the MPCA standard is 30 mg/L for class 2B waters. The MPCA's protocols for assessments are as follows:

“A stream is considered to exceed the standard for TSS if 1) the standard is violated more than 10% of the days of the assessment season (April through September) as determined from a data set that gives an unbiased representation of conditions over the assessment season, and 2) at least three measurements violate the standard. A stream is considered to meet the standard for TSS if the standard is met at least 90% of the days of the assessment season. A designation of meeting the standard for TSS generally requires at least 20 suitable measurements from a data set that gives an unbiased representation of conditions over at least two different years. However, if it is determined that the data set adequately targets periods and conditions when exceedances are most likely to occur, a smaller number of measurements may suffice.”

Perro Creek is also listed as impaired for *E. coli* bacteria on the MPCA's 303(d) Impaired Waters List. *E. coli* is used as an indicator in waterbodies for the possible presence of fecal contamination, including pathogens. The primary source of *E. coli* is human and animal waste, making high *E. coli* presence a concern for human health. A summary table by month can be found in Table 8. The MPCA standard is defined as follows, and is based on the latest ten years of data as per MPCA protocol:

“Not to exceed 126 organisms per 100 milliliters as a geometric mean of not less than five samples representative of conditions within any calendar month, nor shall more than ten percent of all samples taken during any calendar month individually exceed 1,260 organisms per 100 milliliters. The standard applies only between April 1 and October 31.”

Table 5. Perro Creek 2023 Monitored Discharge and TP & TSS Loading

Site	Date range	Discharge (cf)	Discharge (ac-ft)	Percent of Total Discharge	TP Load (lbs)	Percent of TP Load	TSS Load (lbs)	Percent of TSS Load
Perro at Diversion Structure Baseflow ¹	5/23/23 - 10/23/23	9,272,163	212.97	72%	14.5	53%	926	18%
Perro at Diversion Structure Stormflow	5/23/23 - 10/23/23	328,303	7.54	3%	4.0	14%	1,766	35%
Perro at Diversion Overflow Baseflow ^{1,2}	5/23/23 - 10/23/23	3,030,828	69.61	23%	4.7	17%	303	6%
Perro at Diversion Overflow Stormflow ²	5/23/23 - 10/23/23	305,354	7.01	2%	4.2	15%	2,095	41%
Total to the St. Croix River		12,936,648	297.14	100%	27.3	100%	5,091	100%

¹ 10/10 TSS result was excluded from the average used for load calculations

² Result averages from samples collected in-stream at the Diversion Structure were used for Diversion Overflow loading calculations

Table 6. Perro Creek at Diversion Structure 2023 Water Quality Results

Start	End	Sample Type	TP (mg/L)	TSS (mg/L)	TKN (mg/L)	Ammonia Nitrogen (mg/L)	Nitrate N (mg/L)	Nitrite N (mg/L)	<i>E. coli</i> (mpn/100 mL)
6/26/23 16:15	6/26/23 16:15	Base Grab ¹	<0.050	<3	0.41				387
7/20/23 11:09	7/20/23 11:09	Base Grab ¹	<0.050	<3	0.32	<0.06	<0.20	<0.06	
7/25/23 10:07	7/25/23 10:07	Base Grab ¹	<0.050	<3	0.31				205
8/24/23 9:55	8/24/23 9:55	Base Grab ¹	<0.050	<4	0.24				68
9/26/23 13:20	9/26/23 13:20	Base Grab ¹	<0.050	<3	0.27				365
10/10/23 8:46	10/10/23 8:46	Base Grab ^{1,2}	<0.050	18	0.33				60
7/21/23 15:19	7/21/23 15:49	Storm Composite	0.181	63	1.12	0.18			
7/24/23 14:48	7/24/23 15:34	Storm Composite	0.308	161	1.71	<0.06	0.41	<0.06	
8/13/23 23:43	8/14/23 2:34	Storm Composite	0.130	32	0.60				
9/23/23 18:48	9/24/23 7:51	Storm Composite	0.089	10	0.55				
9/30/23 6:46	9/30/23 8:44	Storm Composite	0.370	243	2.95	<0.06	0.20	<0.06	

¹ TP/TSS results that are less than the Reporting Limit were divided in half when calculating averages

² TSS result excluded from average

Table 7. Perro Creek Historical TP and TSS Averages and Ranges

Perro @ Diversion Sample Type	2016	2017	2018	2019	2020	2021 ^a	2022 ^a	2023
Baseflow Samples	8	6	8	6	No Samples	6	5	6
Stormflow Samples	5	5	4	3	No Samples	8	9	5
TP (mg/L) - Baseflow Average <i>Baseflow Range^b</i>	0.051 ~0.023 - 0.090	0.046 <0.020 - 0.120	0.036 0.020 - 0.058	0.034 0.021 - 0.065	No Samples	0.035 0.024 - 0.210	0.015 <0.020 - 0.065	NA <0.05
TP (mg/L) - Stormflow Average <i>Stormflow Range</i>	0.435 0.126 - 1.330	0.108 ~0.023 - 0.218	0.124 0.047 - 0.252	0.372 0.133 - 0.597	No Samples	0.427 0.185 - 0.862	0.279 <0.020 - 0.524	0.216 0.089 - 0.370
TSS (mg/L) - Baseflow Average <i>Baseflow Range^c</i>	16 <1 - 77	12 ~1 - 60	4 1 - 16	2 1 - 3	No Samples	2 1 - 33	3 <3 - 18	2 <3 - 18
TSS (mg/L) - Stormflow Average <i>Stormflow Range</i>	118 32 - 308	36 12 - 76	20 8 - 31	58 21 - 97	No Samples	217 75 - 429	86 3 - 154	102 10 - 243

^a Results from base composite sample excluded from averages (Sampled during initial opening of Perro Pond outlet)

^b In 2023 the laboratory changed TP reporting to as low as the Reporting Limit (0.05 mg/L) rather than the Method Detection Limit (0.02 mg/L). All baseflow results were <0.05 mg/L

^c Beginning in 2022 the laboratory changed TSS reporting to as low as the Reporting Limit (3 mg/L) rather than the Method Detection Limit (1 mg/L)

Table 8. Monthly Geometric Means of *E. coli*- Latest Ten Years

Site	April	May	June	July	August	September	October
Perro at Diversion Structure ¹	Insufficient Data	111	391	230	139	439	167
	Exceeds geometric mean of 126 #/100mL from not less than 5 samples in a calendar month, collected in last 10 yrs						

¹ >10% of samples collected in the last 10 years exceeded 1,260 #/100mL


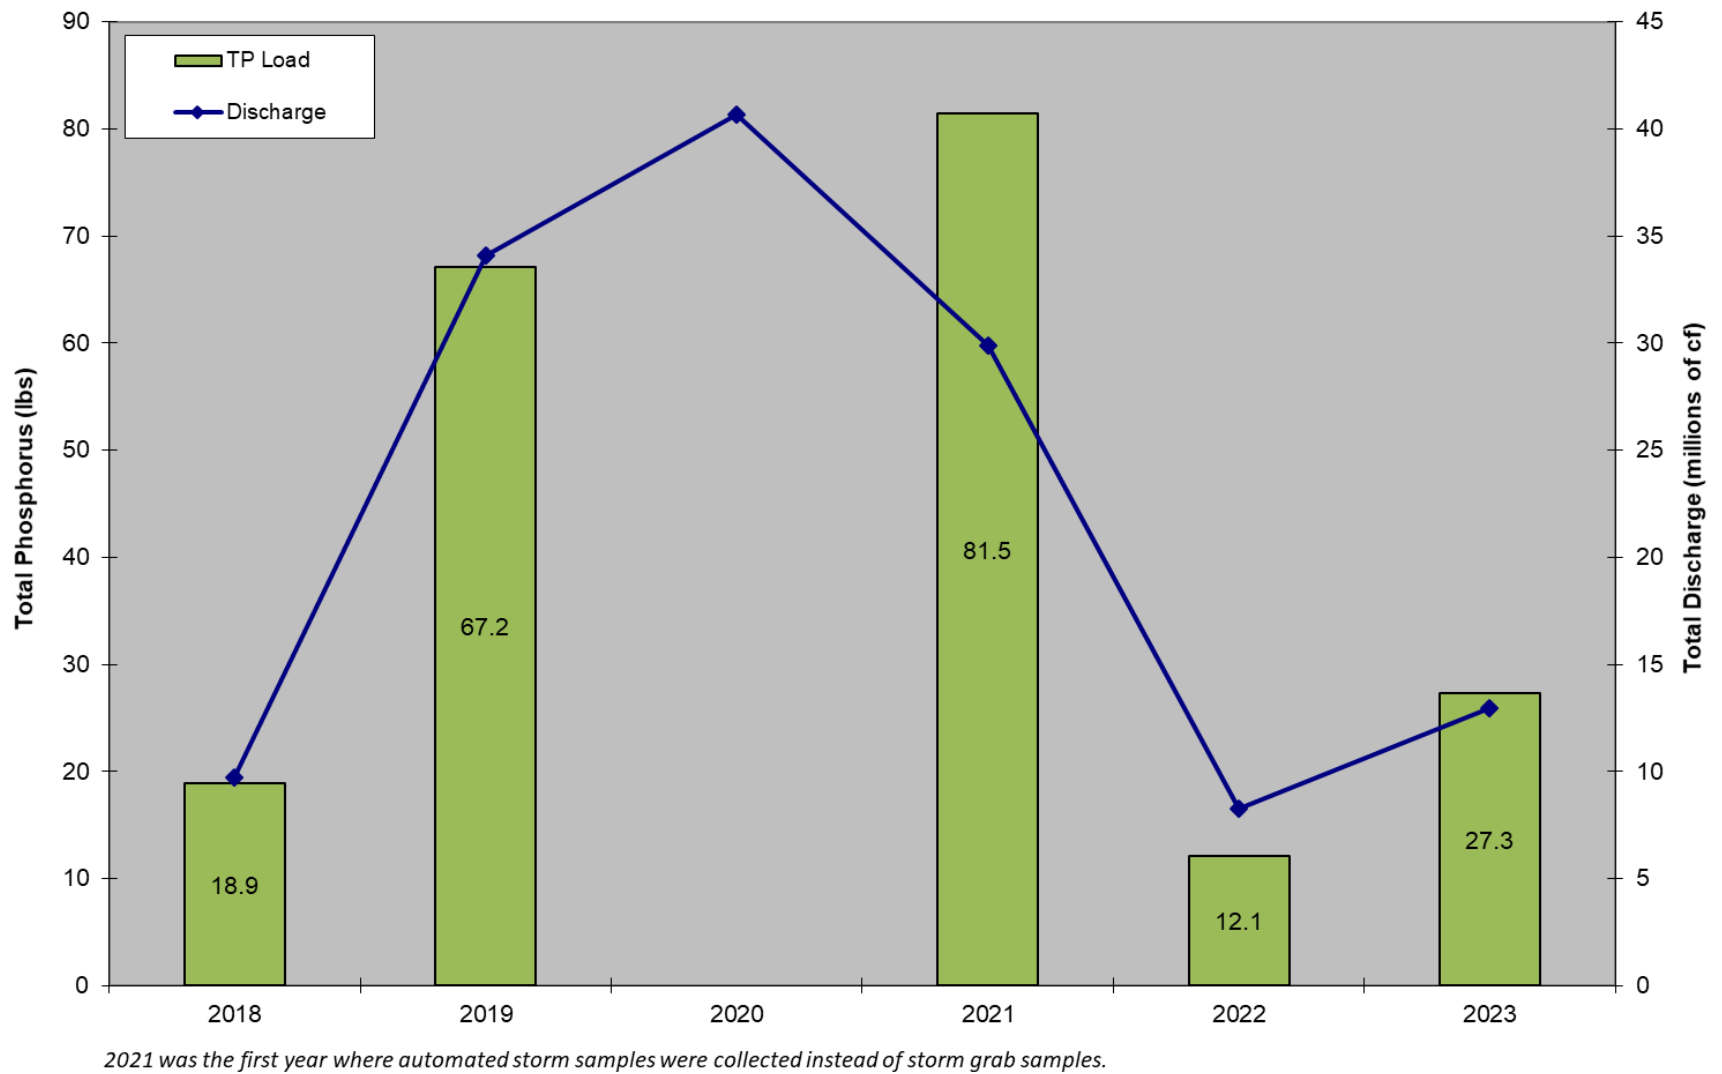


Figure 8. Perro Creek at Diversion Structure Monitored Discharge and Total Phosphorus Load

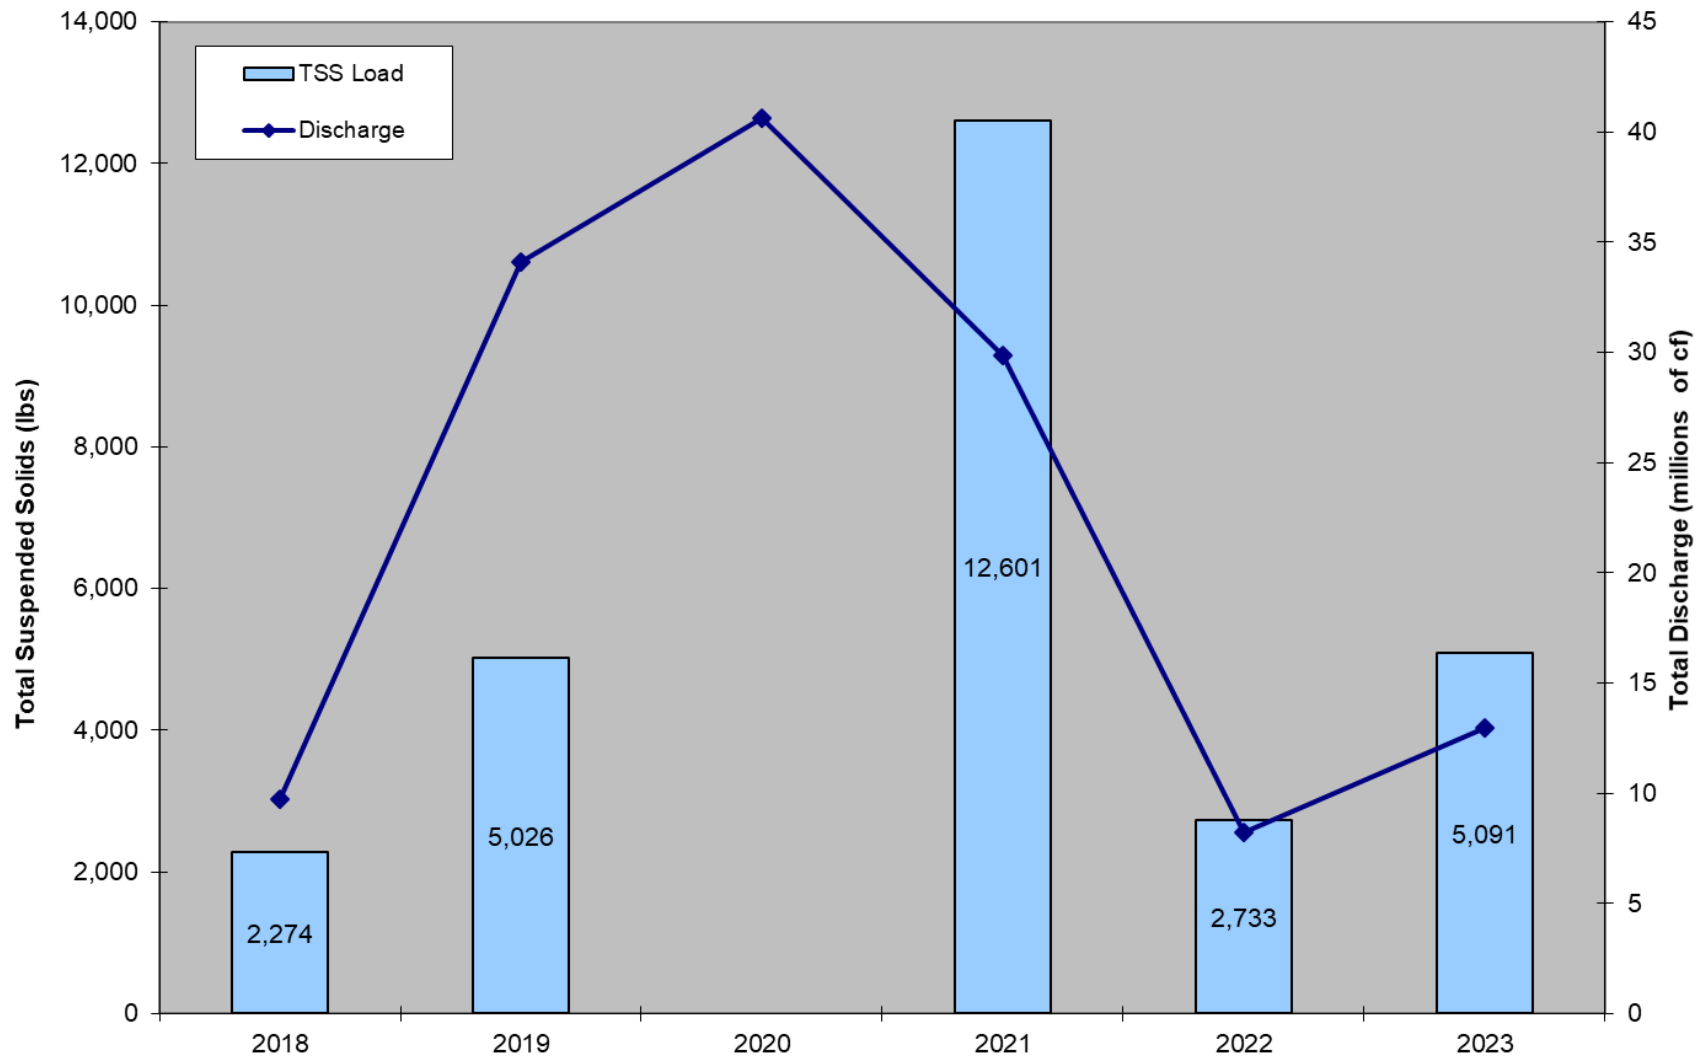

2021 was the first year where automated storm samples were collected instead of storm grab samples.

Figure 9. Perro Creek at Diversion Structure Monitored Discharge and Total Suspended Solids Load

C. BROWN'S CREEK DIVERSION STRUCTURE

As part of Brown's Creek Watershed District's long-term monitoring, the WCD collected grab samples and automated flow-weighted samples during both baseflow and storm event conditions at the Brown's Creek Diversion Structure for BCWD in 2023, and that data is provided to the MSCWMO. The City of Stillwater constructed the diversion structure in June of 2003, as part of the completion of the Trout Stream Mitigation Project (TSMP). It has been functioning to divert water from the 1,800-acre annexation area away from Brown's Creek through McKusick Lake, and ultimately to the St. Croix River. While this diversion structure keeps the warmer urban stormwater runoff from the southern tributary out of the temperature and nutrient sensitive Brown's Creek Ravine, it means that this is discharged to McKusick Lake and does affect the lake water quality. Data collected at this site by the WCD includes continuous stage and total discharge, and water quality samples analyzed for nutrients, sediment, and metals. Discharge decreased from 2022 to 35,622,586 cubic feet exported to McKusick Lake, due to a third consecutive year of drought (Table 9). All stream flow and chemistry data from 2023 can be found in Table 9 and Table 10.

The TP load to McKusick Lake was 367 lbs, or 0.095 lbs of phosphorus per acre of watershed land, and the TSS load was 74,875 lbs of sediment, or 19.42 lbs per acre (Table 9). Erosional head cuts on the tributary branches of the creek were identified as a source of TP and TSS loads. BCWD has worked since 2018 to repair head cuts and increase floodplain connectivity through the installation of rock vanes. Beaver activity and dams were reported upstream of the monitoring site and near the Iron Enhanced Sand Filter (IESF) harvest pond. The dams can enhance floodplain connectivity and settling of nutrients while improving habitat, and a resulting reduction in TP and TSS loads is likely reflected in annual loads. Due to these considerations BCWD opted to leave the dams in place. The IESF also continues to operate to reduce TP loads in the drainage.

The calculation of MPCA metal standards is described in the Minnesota Administrative Rules Part 7050.0222 and are divided into three categories of toxicity; chronic, maximum, and final acute value (FAV). The chronic standard protects organisms from long term exposure to a pollutant with minimal effects, the maximum standard from short term exposure with no or little

mortality, and the FAV is the concentration at which mortality can be expected. In 2023 one sample result exceeded the chronic standard for copper and two results exceeded the chronic standard for lead. The number and severity of exceedances of metals standards at this site were among the lowest observed since metals analysis began in 2007. A lack of major runoff events due to drought conditions and improvements made to reduce erosion are the most likely drivers of this. In most cases, severe exceedances of metals seem to be associated with extreme TSS concentrations. Sources of metals may include improperly disposed wastes, such as deep cycle batteries. The combination and concentration of metals observed over time appear to point to this as a possible source.

Table 9. Brown’s Creek Diversion Historic Annual Discharge and Loading- Latest Ten Years

	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023
Brown’s Creek Diversion Structure										
Discharge (cf)	53,519,017	46,276,327	70,780,581	39,625,672	45,453,990	112,468,888	68,165,935	46,792,341	41,610,620	35,622,586
Total pounds of Phosphorus exported	392	1,837	1,574	784	964	3,598	760	446	389	367
TP (lbs/ac/yr)	0.102	0.447	0.408	0.203	0.250	0.933	0.197	0.116	0.101	0.095
Total pounds of TSS exported	99,532	1,008,346	1,533,496	596,382	505,314	2,707,186	246,238	401,069	75,429	74,875
TSS (lbs/ac/yr)	25.82	261.57	397.79	154.70	131.08	702.25	63.87	104.01	19.57	19.42

Table 10. Brown’s Creek Diversion 2023 Chemistry Results

Sample Type	Start	End	TSS (mg/L)	VSS (mg/L)	TKN (mg/L)	TP (mg/L)	Dissolved P (mg/L)	Copper (mg/L)	Nickel (mg/L)	Lead (mg/L)	Zinc (mg/L)	Cadmium (mg/L)	Chromium (mg/L)	Chloride (mg/L)	Nitrite N (mg/L)	Nitrate N (mg/L)	Ammonia Nitrogen (mg/L)	Hardness (mg/L _CaCO3)
Snowmelt Grab	2/15/2023 11:15	2/15/2023 11:15	7	<3	0.70	0.088	0.055	0.00120	0.00070	<0.00050	<0.00500	<0.00010	<0.00250	74.8	<0.06	0.90	0.11	124
Snowmelt Grab	4/10/2023 9:40	4/10/2023 9:40	7	5	0.54	0.080	<0.020	<0.00100	0.00053	<0.00050	<0.00500	<0.00010	<0.00250	76.7	<0.06	0.36	<0.06	75
Storm Composite	7/4/2023 12:26	7/4/2023 23:55	100	29	1.66	0.333	0.072	0.00360	0.00270	0.00160	0.02020	0.00018	<0.00250	47.9	<0.06	<0.20	<0.06	177
Storm Composite	8/14/2023 2:44	8/14/2023 8:14	98	27	1.37	0.337	0.109	0.00240	0.00210	0.00110	0.00980	0.00024	<0.00250	43.6	<0.06	0.50	0.08	215
Storm Composite	9/24/2023 3:01	9/24/2023 10:34	104	31	1.65	0.435	0.075	0.00310	0.00260	0.00150	0.01130	0.00010	<0.00250	46.0	<0.06	0.69	<0.06	206
Storm Composite	9/25/2023 18:06	9/25/2023 23:23	58	18	1.22	0.323	0.075	0.00380	0.00240	0.00140	0.01480	0.00012	<0.00250	45.2	<0.06	0.44	<0.06	172
Storm Composite	9/30/2023 5:02	9/30/2023 15:38	369	94	5.46	1.570	0.108	0.01130	0.01010	0.01010	0.04840	0.00039	0.00950	75.0	<0.06	0.21	<0.06	112
Storm Composite	10/13/2023 4:46	10/14/2023 3:39	218	56	2.24	0.514	0.064	0.00510	0.00440	0.00390	0.01660	0.00016	0.00440	74.8	<0.06	0.29	<0.06	112
Base Grab	5/24/2023 8:51	5/24/2023 8:51	5	<3	0.60	0.082	-0.042	<0.00100	0.00075	<0.00050	<0.00500	<0.00010	<0.00250	97.0	<0.06	0.34	0.09	192
Base Grab	6/23/2023 9:59	6/23/2023 9:59	10	3	0.53	0.144	0.066	<0.00100	0.00087	<0.00050	<0.00500	<0.00010	<0.00250	47.8	<0.06	0.41	0.14	283
Base Grab	7/27/2023 12:29	7/27/2023 12:29	3	<3	0.50	0.101		<0.00100	0.00086	<0.00050	<0.00500	<0.00010	<0.00250	49.6	<0.06	0.25	0.06	235
Base Grab	8/24/2023 8:36	8/24/2023 8:36	3	<3	0.30	0.097	<0.050	<0.00100	0.00071	<0.00050	<0.00500	<0.00010	<0.00250	49.4	<0.06	0.32	<0.06	290
Base Grab	9/14/2023 8:41	9/14/2023 8:41	13	4	0.32	0.115	0.062	0.00130	0.00130	<0.00050	0.00620	<0.00050	<0.00250	49.2	<0.06	0.66	<0.06	273
Base Grab	10/10/2023 13:31	10/10/2023 13:31	<3	<3	0.53	0.075	<0.050	0.00100	0.00067	<0.00050	<0.00500	<0.00010	<0.00250	111.0	<0.06	0.51	0.08	214
	Exceeds Water Quality Standard																	
	No Exceedance Determinable																	
	Exceeds Chronic Standard																	
	Exceeds Max Standard																	
	Exceeds Final Acute Standard																	

MSCWMO: CONCLUSIONS AND RECOMMENDATIONS

A. LAKES

Lake monitoring in MSCWMO continues to provide valuable baseline water quality information. To determine the health of the lakes in MSCWMO, physical and chemical parameters are compared on a year-to-year basis and to other lakes in the region. Water quality in a lake depends on a number of different variables such as: size of the contributing watershed, external nutrient sources, depth of the lake, and the current amount of nutrients available to be periodically released from the lake bottom. Low water quality ratings of MSCWMO lakes are most likely due to long-term contribution of urban runoff (Lily Lake) or due to the sensitivity of shallow lakes being prone to summertime mixing (McKusick Lake). Shallow lakes typically exist in a low algal production, clear-water state with abundant aquatic macrophytes or in a high-algal production, turbid water state. Shallow lakes may not completely stratify in the summer, and therefore have the capability to continually mix throughout the summer. That mixing causes phosphorus to be distributed throughout the water column, causing more frequent and heavy algal blooms. This is unlike deeper, stratified lakes where phosphorus below the thermocline is not available for primary production.

The MPCA listed both Lily and McKusick Lake on the 303(d) Impaired Waters list for nutrient/eutrophication impairment. If a water body is listed, it indicates that it does not currently meet water quality criteria. McKusick Lake was delisted in 2012 because restoration activities within its watershed led the lake to meet the water quality standards. In 2022, the MPCA delisted Lily Lake because the lake was meeting the standards due to restoration activities within its watershed.

Summertime (June-September) TP, chlorophyll- α , and Secchi disk transparency averages have remained relatively consistent over the last twenty years in Lily Lake with the exceptions of 1995, 2001, 2009, 2013, and 2014 where overall water quality dramatically improved (Figure 2, Figure 3, and Figure 5). In 2001 phosphorus and chl- α levels dropped and the lake grade improved significantly. In 2006-2008, summer average TP, chl- α , and Secchi disk transparency deteriorated when compared to the averages seen from 2001 to 2005. In 2023 Lily Lake received

a grade of an A, matching the grade from 2022 and well above the long-term average lake grade of a C+.

The cause of these one-year increases (1995, 2001, 2009, 2013, and 2014) in water quality is presently unknown, and there may be several possible explanations which could be investigated further in the future. Lily Lake has received herbicide and algaecide treatments from 1995-2011 and 2016-2018. In 2018-2021 the City of Stillwater and the Lily Lake Association did not request any large-scale herbicide and algaecide treatments but individual landowner treatments have occurred. In 2010 a native buffer planting was installed at the public access and the Lily Lake watershed underwent a subwatershed assessment. As a result, fifteen raingardens were constructed in the Lily Lake watershed from 2011-2012, six large raingardens were installed in 2014, a gully stabilization project installed at Lakeview Hospital discharging to Brick Pond in 2017, and a large gully stabilization and stormwater treatment system discharging to Brick Pond in 2018. In 2019 another raingarden was installed. Construction of a large infiltration basin in the Greeley storm catchment subwatershed was completed in 2022 and the lake was treated with alum on May 24th, 2022. The effects of these BMPs may have been seen from 2012 to 2023 monitoring seasons with the 2016-2023 seasons having a statistically significant ($p < 0.05$) improving trend for total phosphorus. Continued monitoring is needed to show changes to long term trends due to the implementation of these BMPs. In 2019 the Lily Lake Phosphorus Reductions for Delisting grant was secured. More information about the Lily Lake Impaired Waters Delisting Road Map can be found at <http://www.mscwmo.org/subwatershed-assessments>.

A subwatershed assessment was conducted on the McKusick Lake watershed in 2010. In 2011 six raingardens were constructed as a result of the subwatershed assessment. With renewed funding, seven additional raingardens were planned to be installed in the McKusick Lake watershed in 2013 but were not due to issues with utilities; instead, six larger raingardens were installed in 2014. The impacts of previously installed raingardens may have been seen in 2017-2023 with statistically significant ($p < 0.05$) improving trends for average TP and average Secchi disk transparency, and a statistically significant trend for average chl- α as of 2023. For more information on the McKusick Lake subwatershed assessment refer to the McKusick Lake Stormwater Retrofit Assessment found at <http://www.mscwmo.org/subwatershed-assessments>.

B. TARGETED MONITORING

The targeted monitoring of Lily Lake had the goal of more accurately identifying the major sources of nutrients to the lake and to help steer targeting and design of stormwater management practices. Based on 2016 results, approximately 78% of phosphorus loading to Lily Lake occurs during storm events and the Greeley Street catchment was one of the highest contributing stormwater catchments during those events. The remaining 22% of the phosphorus load was from Brick Pond discharging to Lily Lake during baseflow conditions. Baseflow from Brick Pond accounted for 65% of the total discharge to the lake in 2016 but the average TP concentrations during those periods were lower than during storm events.

The drought conditions in 2023 caused a decrease in flow and affected baseflow and stormflow sampling. Brick Pond was low or not flowing out for much of the monitored period. These conditions combined with datalogger malfunctions resulted in the lowest monitored discharge at the site since monitoring began in 2015. Stormflow periods in 2023 accounted for only 4% of the monitored discharge to Lily Lake, and no storm samples were able to be collected. Based on storm sample results from 2020-22, 11% of the TP load and 27% of the TSS load occurred during these periods. For comparison, stormflow periods in 2022 accounted for 7% of the monitored discharge, 20% of the TP load, and 39% of the TSS load. No monitoring activities are planned for this site in 2024.

C. STREAMS

Water quality sampling continued on Perro Creek at the Diversion Structure in 2023. Drought conditions caused decreases in flow and affected baseflow and stormflow sampling. Only five storm samples were able to be collected. Stormflow periods accounted for only 5% of the monitored discharge to the St. Croix River but 30% of the TP load and 76% of the TSS load occurred during these periods in 2023. For comparison, stormflow periods in 2022 accounted for 3% of the monitored discharge, 40% of the TP load, and 55% of the TSS load. Flow-weighted composite samples should continue to be collected to more accurately calculate TP and TSS loads during storm events.

Perro Creek is listed as impaired for TSS on the MPCA's 303(d) Impaired Waters List and is assessed using an unbiased dataset. Flow-weighted composite samples are considered biased towards higher flow periods because more samples are collected during the higher flows, and these samples are therefore not used for TSS assessments. In 2023 there were no TSS results from grab samples collected April – September that exceeded the MPCA standard of 30 mg/L for class 2B waters. Water quality grab samples should continue to be collected at Perro Creek during different levels of flow to provide an unbiased dataset for assessing the stream for the TSS impairment.

Perro Creek is listed as impaired for *E. coli* bacteria on the MPCA's 303(d) Impaired Waters List. The 10-year geometric means in June – October exceed the MPCA standard, while the May geometric mean meets the standard. All samples collected in 2023 at the Diversion Structure (June – October) were less than the monthly geometric means from the last 10 years of data for the site. This is an improvement from 2022 when the May, July, and October samples were higher than the monthly geometric means. Monthly *E. coli* samples should continue to be collected from May through October at Perro Creek to expand the dataset for calculating monthly geometric means.


APPENDIX A
WATER QUALITY DATA – LILY LAKE AND MCKUSICK LAKE

This Page Intentionally Left Blank.

LILY LAKE



2023 Lake Grade: A

- DNR ID #: 820023
- Municipality: City of Stillwater
- Location: NE ¼ Section 32, T30N-R20W
- Lake Size: 35.90 Acres
- Maximum Depth (2023): 45 ft
- Ordinary High Water Mark: 844.8 ft
- 55% Littoral
- Note: Littoral area is the portion of the lake <15 ft and dominated by aquatic vegetation.
- Publicly accessible

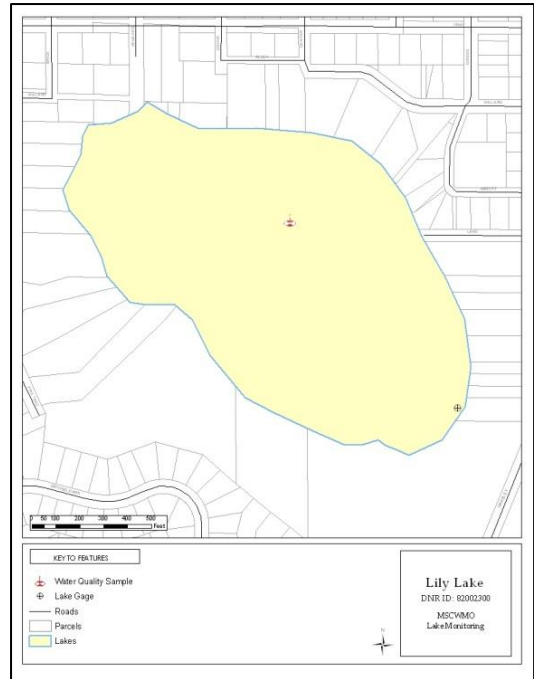

Summary Points

- Based on the chlorophyll- α results Lily Lake was considered oligotrophic in 2023, according to the Carlson Trophic State Index.
- Using a Kendall's Tau correlation test ($p < 0.05$) there is a statistically significant **improving** trend for average total phosphorus and average Secchi transparency, and no trend is present for average chlorophyll- α .
- The major land use is urban/residential.
- The lake stratified in 2023 with the thermocline between 4-6 meters deep.
- The lake was treated with alum on May 24th, 2022.
- Lily Lake was delisted in 2022 for its impairment for nutrients on the Minnesota Pollution Control Agency's Impaired Waters List.
- Lab methodology was changed for 2023 total phosphorus sample analysis, as such no results were reported <0.022 mg/L (April-mid September).

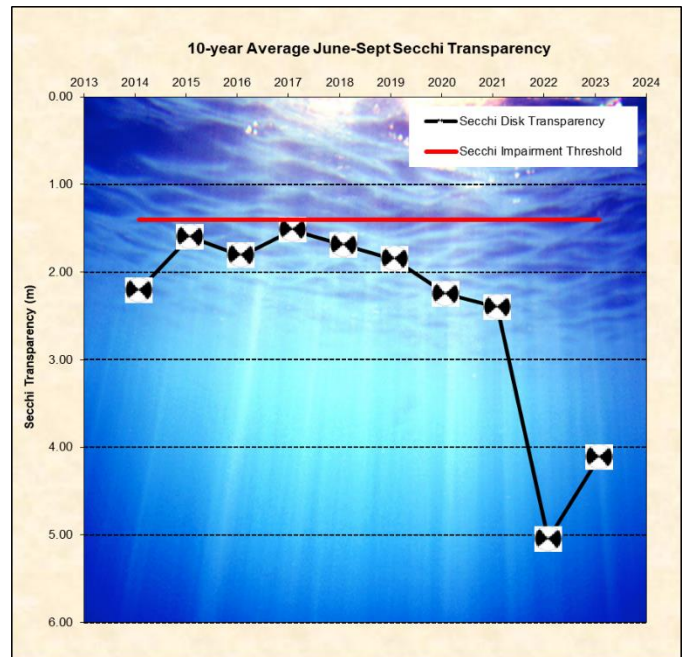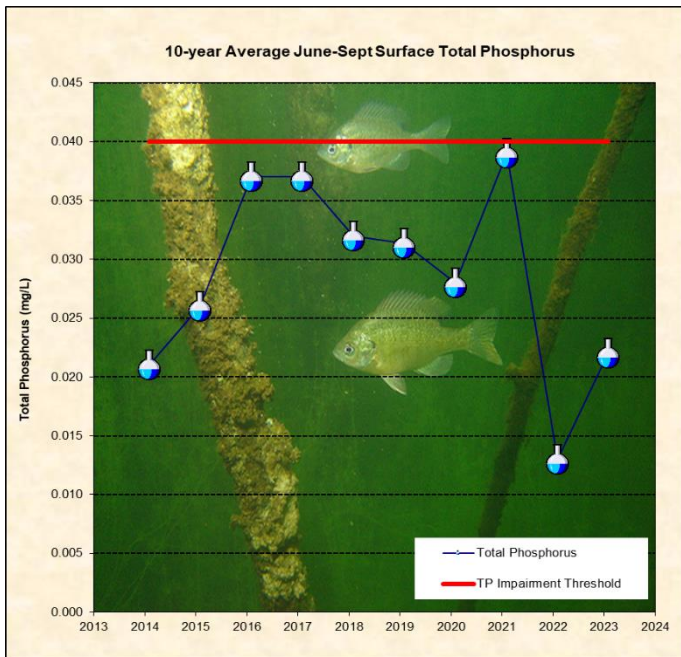


Date/Time	Total Phosphorus (mg/L)	Uncorrected Trichromatic Chlorophyll-a (ug/L)	Pheophytin-Corrected Chlorophyll-a (ug/L)	Total Kjeldahl Nitrogen (mg/L)	Secchi Disk Depth (m)	Surface Temperature (Celsius)	Surface Dissolved Oxygen (mg/L)
4/24/2023 13:11	0.022	4.6	4.0	0.57	3.05	6.5	8.61
5/9/2023 8:08	0.022	1.9	1.9	0.49	5.18	16.9	12.09
5/22/2023 9:25	0.022	1.0	1.0	0.49	6.71	19.1	10.69
6/7/2023 10:04	0.025	1.3	1.1	0.43	4.42	25.4	10.94
6/20/2023 14:05	0.022	2.0	1.6	0.49	4.88	25.1	12.31
7/5/2023 8:55	0.022	3.7	2.7	0.41	4.57	26.1	9.30
7/18/2023 8:19	0.022	3.5	2.7	0.50	4.27	23.1	9.81
8/1/2023 14:02	0.023	2.7	2.1	0.43	3.66	26.7	8.88
8/17/2023 8:11	0.022	4.5	4.0	0.62	3.20	23.7	8.35
8/31/2023 8:00	0.022	3.2	2.7	0.56	2.74	23.9	10.08
9/12/2023 11:50	0.022	2.7	2.4	0.54	4.72	21.6	9.33
9/27/2023 8:01	0.020	3.7	3.5	NA	4.57	19.9	8.86
10/10/2023 10:15	0.013	7.1	6.7	NA	3.81	16.2	10.16
2023 Average	0.021	3.2	2.8	0.50	4.29	21.1	9.95
2023 Summer Average	0.022	3.0	2.5	0.50	4.11	23.9	9.76

Water quality thresholds are 0.04 mg/L TP, 14 µg/L CL-a, 1.4 m Secchi depth*
 Shallow lake water quality thresholds are 0.06 mg/L TP, 20 µg/L CL-a, 1.0 m Secchi depth*

	High	High Date	Low	Low Date	Average
2023 Elevation (ft)	846.42	4/24/2023	844.60	9/12/2023	845.19

*Data requirements and determinations of use assessment according to the MPCA's Guidance Manual for Assessing the Quality of Minnesota Surface Waters: "Samples must be collected over a minimum of 2 years and data used for assessments must be collected from June to September. Typically, a minimum of 8 individual data points for TP, corrected chlorophyll-a (chl-a corrected for pheophytin), and Secchi are required. Data used for phosphorus and chlorophyll-a calculations are limited to those collected from the upper most 3 meters of the water column (surface). If more than one sample is collected in a lake per day, these values are averaged to yield a daily average value. Following this step, all June to September data for the 10-year assessment window are averaged to determine summer-mean values for TP, corrected chl-a, and Secchi depth. These values are then compared to the standards and the assessment is made."

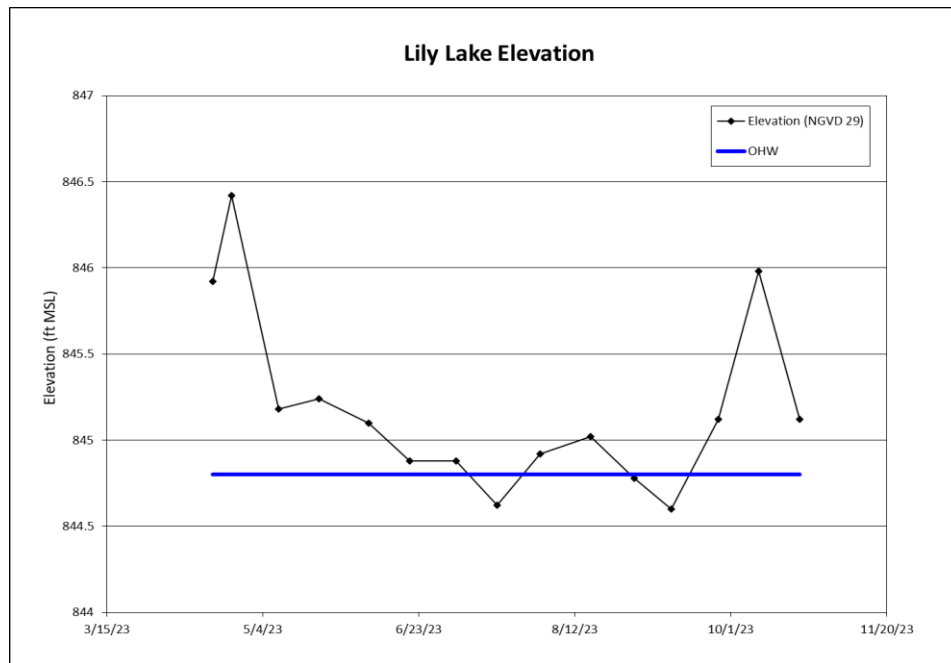

Lake Water Quality Summary											
	Summertime Lake Grades (May-Sept)										
	2023	2022	2021	2020	2019	2018	2017	2016	2015	2014	2013
Total Phosphorus (mg/L)	A	A	C	B	B	B	C	C	B	A	B
Chlorophyll-a (ug/L)	A	A	C	B	B	B	B	C	C	B	B
Secchi depth (ft)	A	A	B	B	C	C	C	B	C	B	B
Overall	A	A	C+	B	B-	B-	C+	C+	C+	B+	B


MCKUSICK LAKE

2023 Lake Grade: B-

DNR ID #: 820020



- Municipality: City of Stillwater
- Location: NE ¼ Section 29, T30N-R20W
- Lake Size: 46 Acres
- Maximum Depth (2023): 14 ft
- Ordinary High Water Mark: 851.7 ft
- 100% Littoral

Note: Littoral area is the portion of the lake <15 ft and dominated by aquatic vegetation.

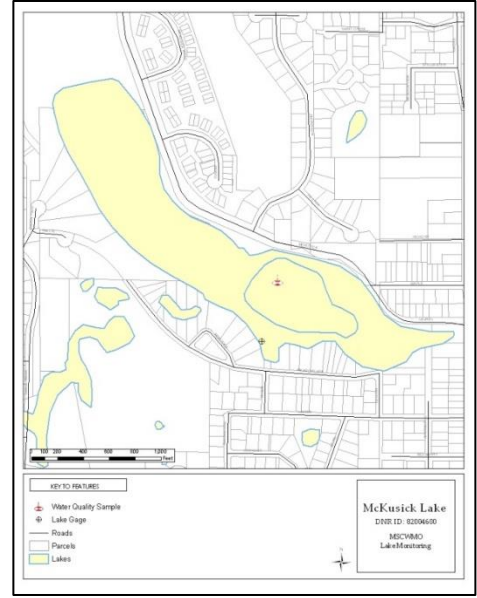

Summary Points

- Based on the chlorophyll- α results McKusick Lake was considered eutrophic in 2023, according to the Carlson Trophic State Index.
- Using a Kendall's Tau correlation test ($p < 0.05$) there is a statistically significant **improving** trend for average Secchi transparency, average total phosphorus, and average chlorophyll- α .
- The major land use is urban/residential.
- Temperature and dissolved oxygen profiles were not collected in 2023 so stratification cannot be determined.
- McKusick Lake was delisted in 2012 for its impairment for nutrients on the Minnesota Pollution Control Agency's Impaired Waters List.

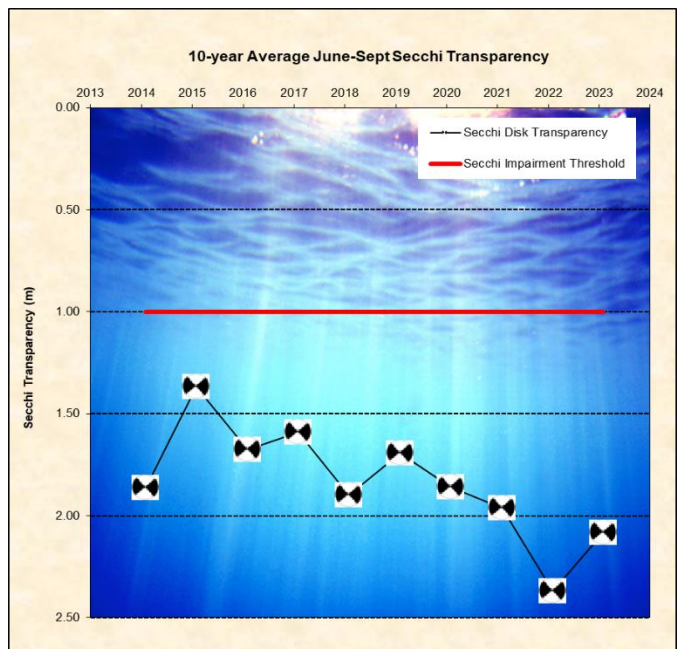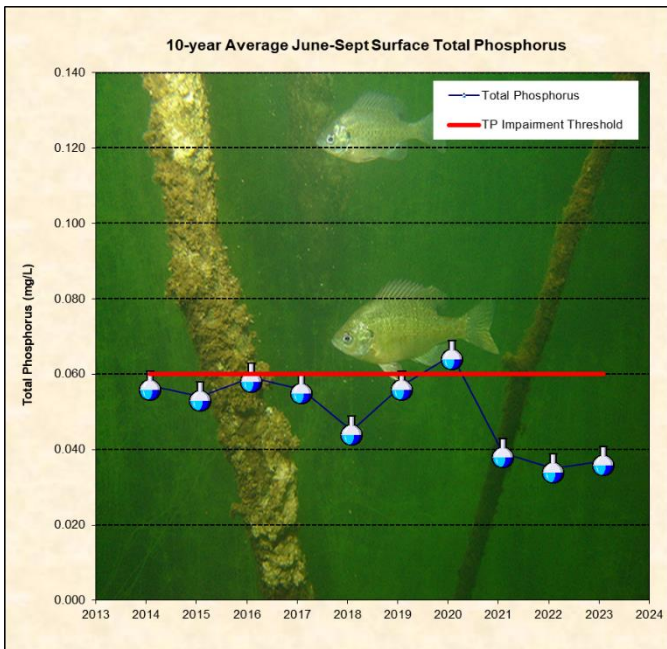


Date/Time	Total Phosphorus (mg/L)	Uncorrected Trichromatic Chlorophyll-a (ug/L)	Pheophytin-Corrected Chlorophyll-a (ug/L)	Total Kjeldahl Nitrogen (mg/L)	Secchi Disk Depth (m)	Surface Temperature (Celsius)	Surface Dissolved Oxygen (mg/L)
4/24/2023 12:04	0.043	17.0	15.0	0.61	1.52	6.6	10.04
5/9/2023 8:47	0.026	7.5	6.9	0.53	1.37	18.2	11.43
5/22/2023 9:55	0.026	2.6	2.4	0.56	3.05	20.0	9.74
6/7/2023 9:39	0.035	5.9	5.3	0.62	2.59	26.0	11.66
6/20/2023 13:39	0.026	10.0	9.9	0.60	2.59	26.2	15.82
7/5/2023 9:33	0.048	8.7	7.5	0.75	2.44	26.3	7.91
7/18/2023 9:13	0.027	7.0	6.4	0.72	2.44	22.5	11.04
8/1/2023 13:33	0.050	14.0	13.0	0.71	1.83	27.0	9.93
8/17/2023 8:37	0.038	8.9	7.7	NA	1.52	22.6	8.18
8/31/2023 8:30	0.024	5.1	4.8	0.81	1.83	23.2	8.92
9/12/2023 11:25	0.044	10.0	9.6	NA	1.98	20.6	9.04
9/27/2023 8:33	0.044	16.0	14.0	NA	1.52	19.2	6.41
10/10/2023 9:46	0.032	7.3	8.0	NA	2.44	13.8	9.88
2023 Average	0.036	9.2	8.5	0.66	2.09	20.9	10.00
2023 Summer Average	0.037	9.5	8.7	0.70	2.08	23.7	9.88

Water quality thresholds are 0.04 mg/L TP, 14 µg/L CL-a, 1.4 m Secchi depth*

Shallow lake water quality thresholds are 0.06 mg/L TP, 20 µg/L CL-a, 1.0 m Secchi depth*

	High	High Date	Low	Low Date	Average
2023 Elevation (ft)	855.06	4/24/2023	853.95	9/12/2023	854.38

*Data requirements and determinations of use assessment according to the MPCA's Guidance Manual for Assessing the Quality of Minnesota Surface Waters: "Samples must be collected over a minimum of 2 years and data used for assessments must be collected from June to September. Typically, a minimum of 8 individual data points for TP, corrected chlorophyll-a (chl-a corrected for pheophytin), and Secchi are required. Data used for phosphorus and chlorophyll-a calculations are limited to those collected from the upper most 3 meters of the water column (surface). If more than one sample is collected in a lake per day, these values are averaged to yield a daily average value. Following this step, all June to September data for the 10-year assessment window are averaged to determine summer-mean values for TP, corrected chl-a, and Secchi depth. These values are then compared to the standards and the assessment is made."

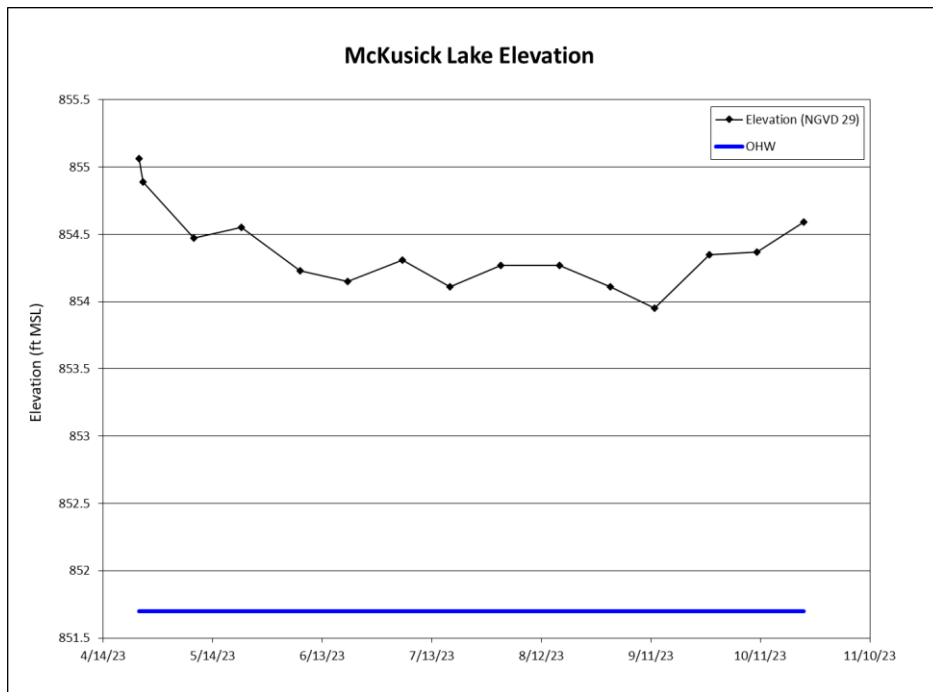

Lake Water Quality Summary										
	Summertime Lake Grades (May-Sept)									
	2023	2022	2021	2020	2019	2018	2017	2016	2015	2014
Total Phosphorus (mg/L)	C	C	C	C	C	C	C	C	C	C
Chlorophyll-a (ug/L)	A	A	A	A	A	B	B	B	C	C
Secchi depth (ft)	C	B	C	C	C	C	C	C	C	C
Overall	B-	B	B-	B-	B-	C+	C+	C+	C	C